

0	ISSUE FOR PERMIT	2019-0228
MARK	REVISIONS	DATE

ALL DIMENSIONS AND RELATIONSHIPS MUST BE VERIFIED BY
CONTRACTOR. THE ARCHITECT IS TO BE NOTIFIED OF ANY
DISCREPANCIES BEFORE PROCEEDING WITH THE CONSTRUCTION.
DO NOT SCALE FROM DRAWINGS.


PROJECT #:	1351
FILENAME:	Odettes_v2017_current.rvt
DRAWN:	Author
CHECKED:	Checker
DATE:	2019-0228

PERMIT SET

PENETRATION
ASSEMBLIES

DRAWING


A610

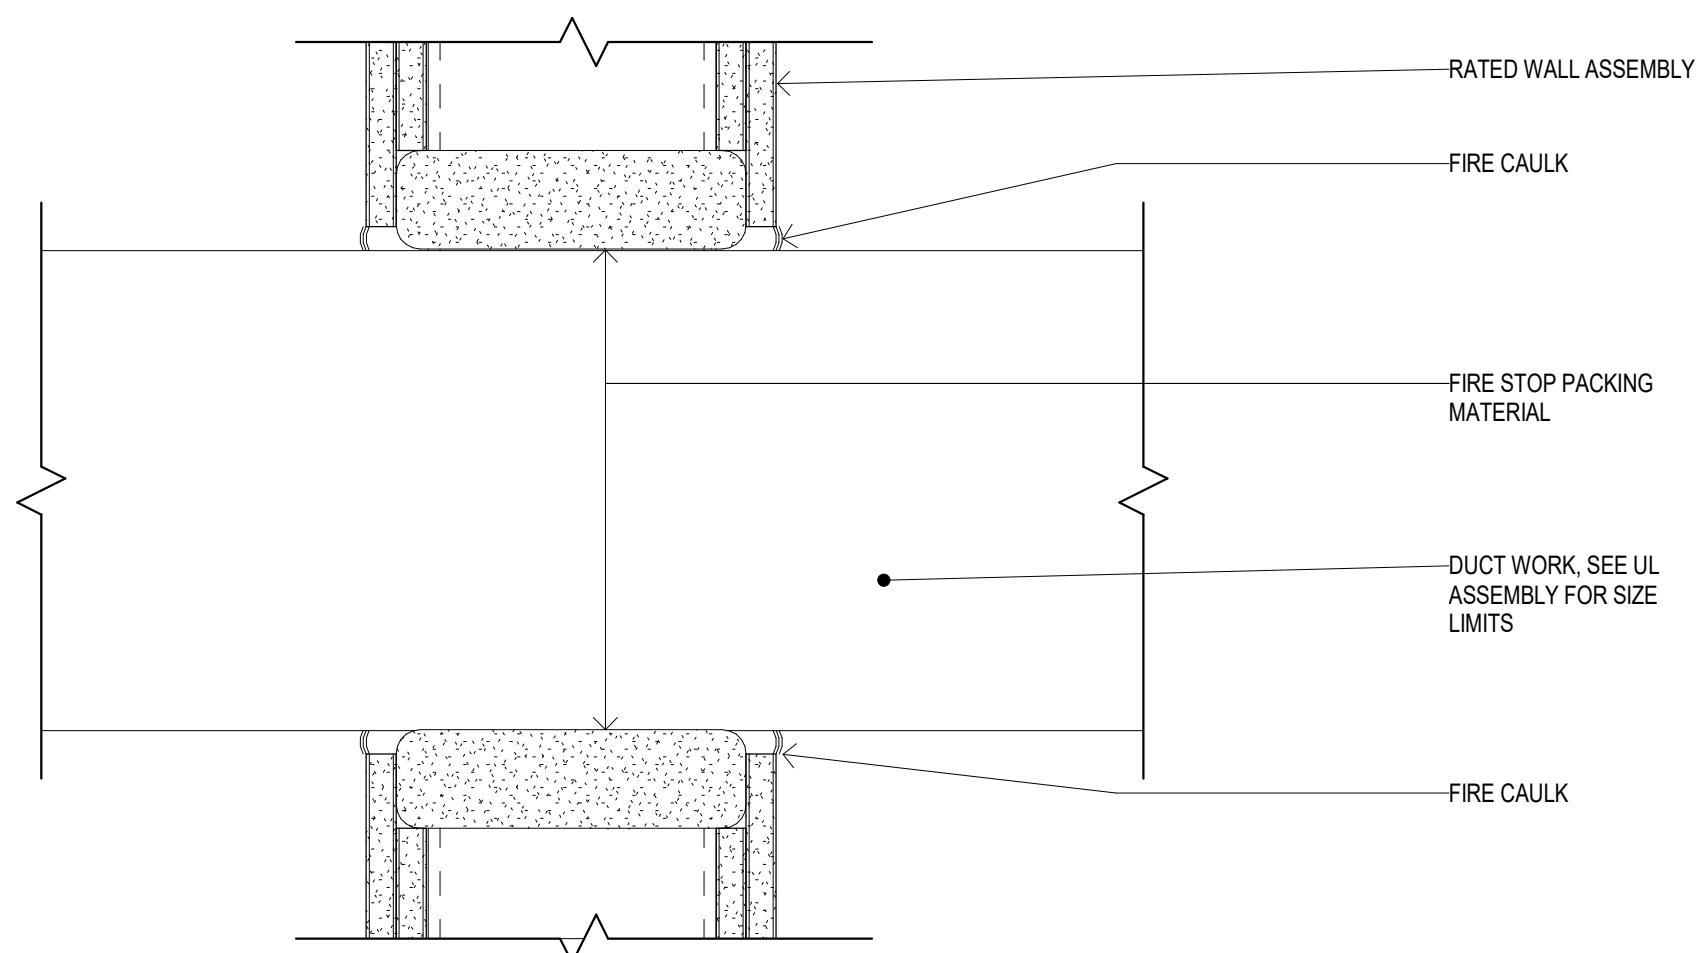

PENETRATION ASSEMBLY # 7

DESCRIPTION: SQUARE DUCT THRU GYPSUM WALL
FIRE RATING: 1 HR
STC RATING: N/A
REFERENCE: 1HR: UL# W-L-7007


7 PENETRATION ASSEMBLY 7 - W-L-7007
A610 3" = 1'-0"

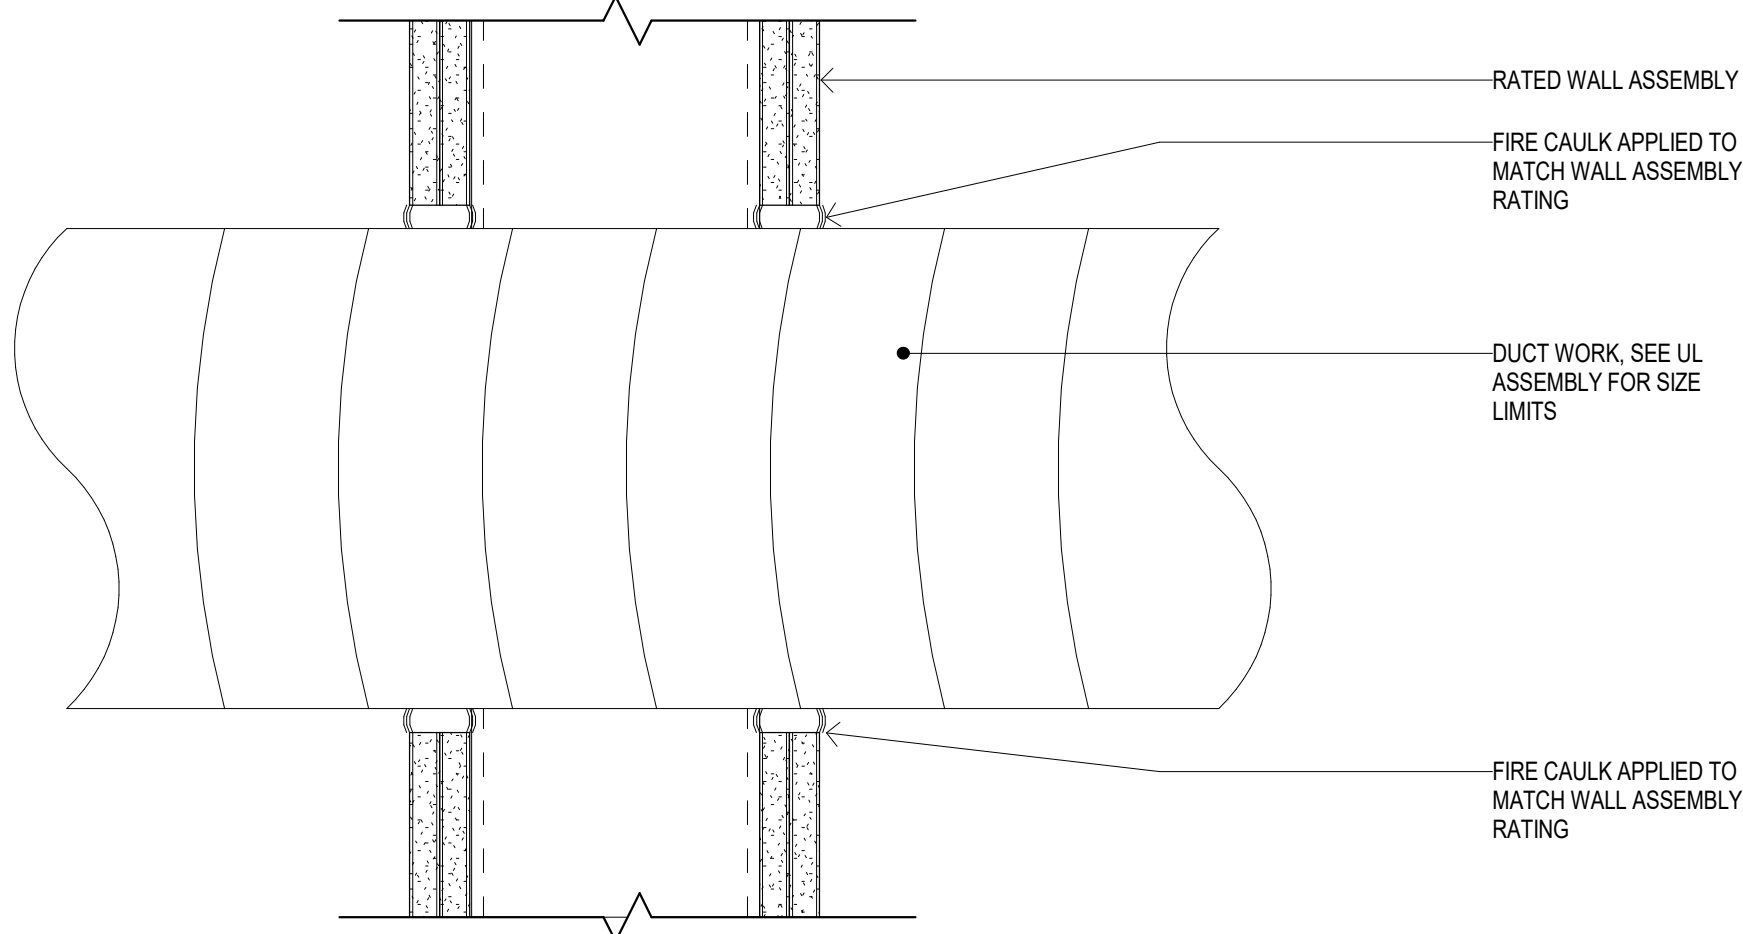

PENETRATION ASSEMBLY # 5

DESCRIPTION: ROUND DUCT THRU GYPSUM WALL
FIRE RATING: 1 HR
STC RATING: N/A
REFERENCE: 1HR: UL# W-L-7045


5 PENETRATION ASSEMBLY 5 - W-L-7045
A610 3" = 1'-0"

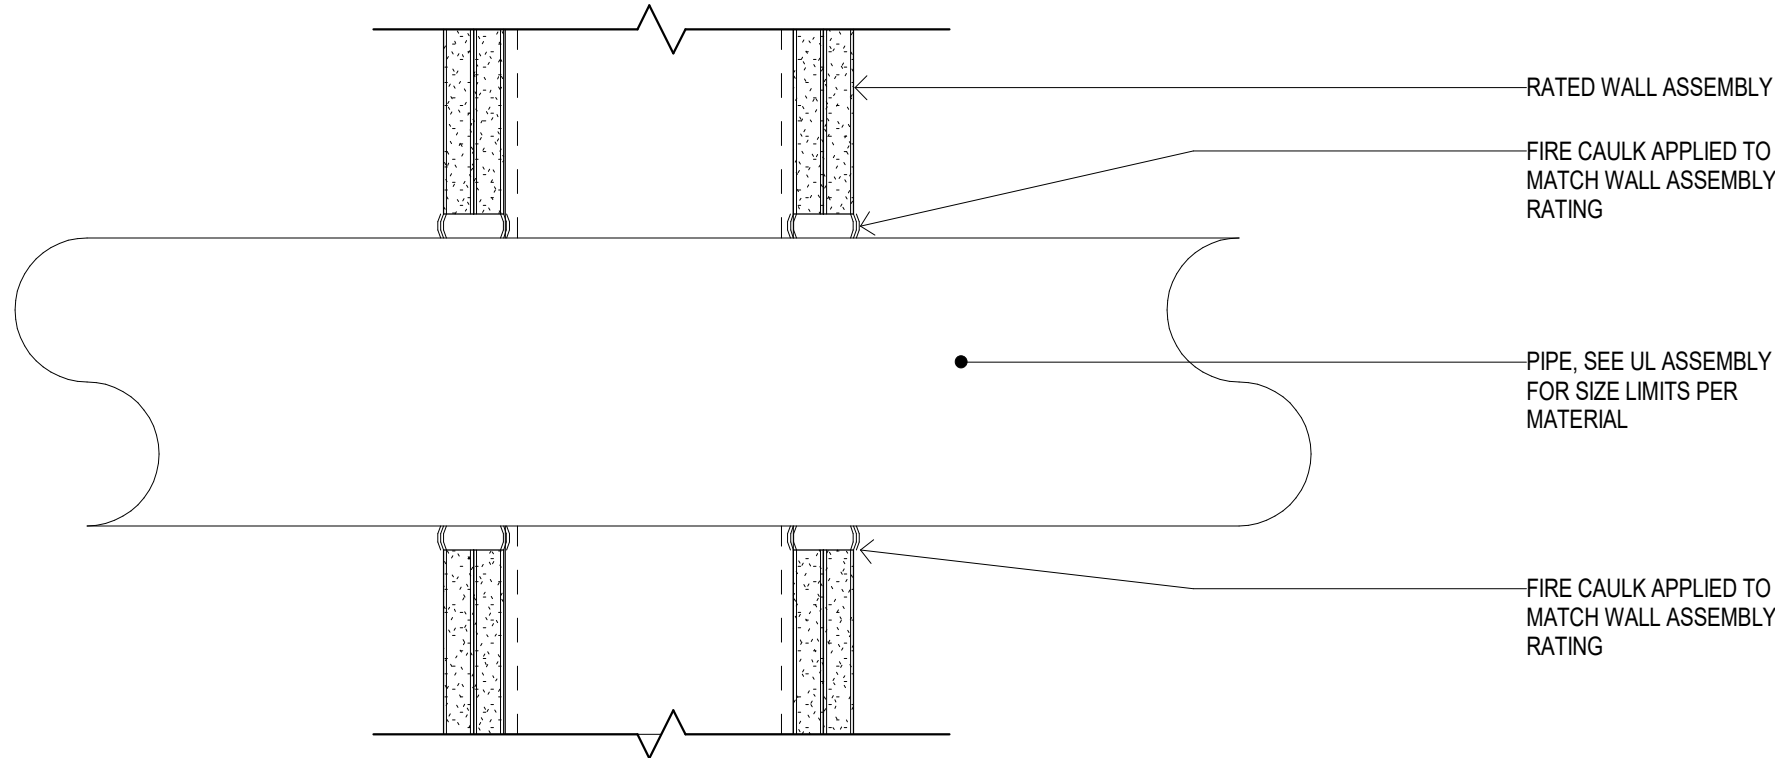

PENETRATION ASSEMBLY # 3

DESCRIPTION: PIPE THRU GYPSUM WALL
FIRE RATING: 1 HR, 3 HR
STC RATING: N/A
REFERENCE: METALIC PIPE: UL# W-L-1001
NON METALIC PIPE: UL# W-L-2126


3 PENETRATION ASSEMBLY 3 - W-L-1001
A610 3" = 1'-0"

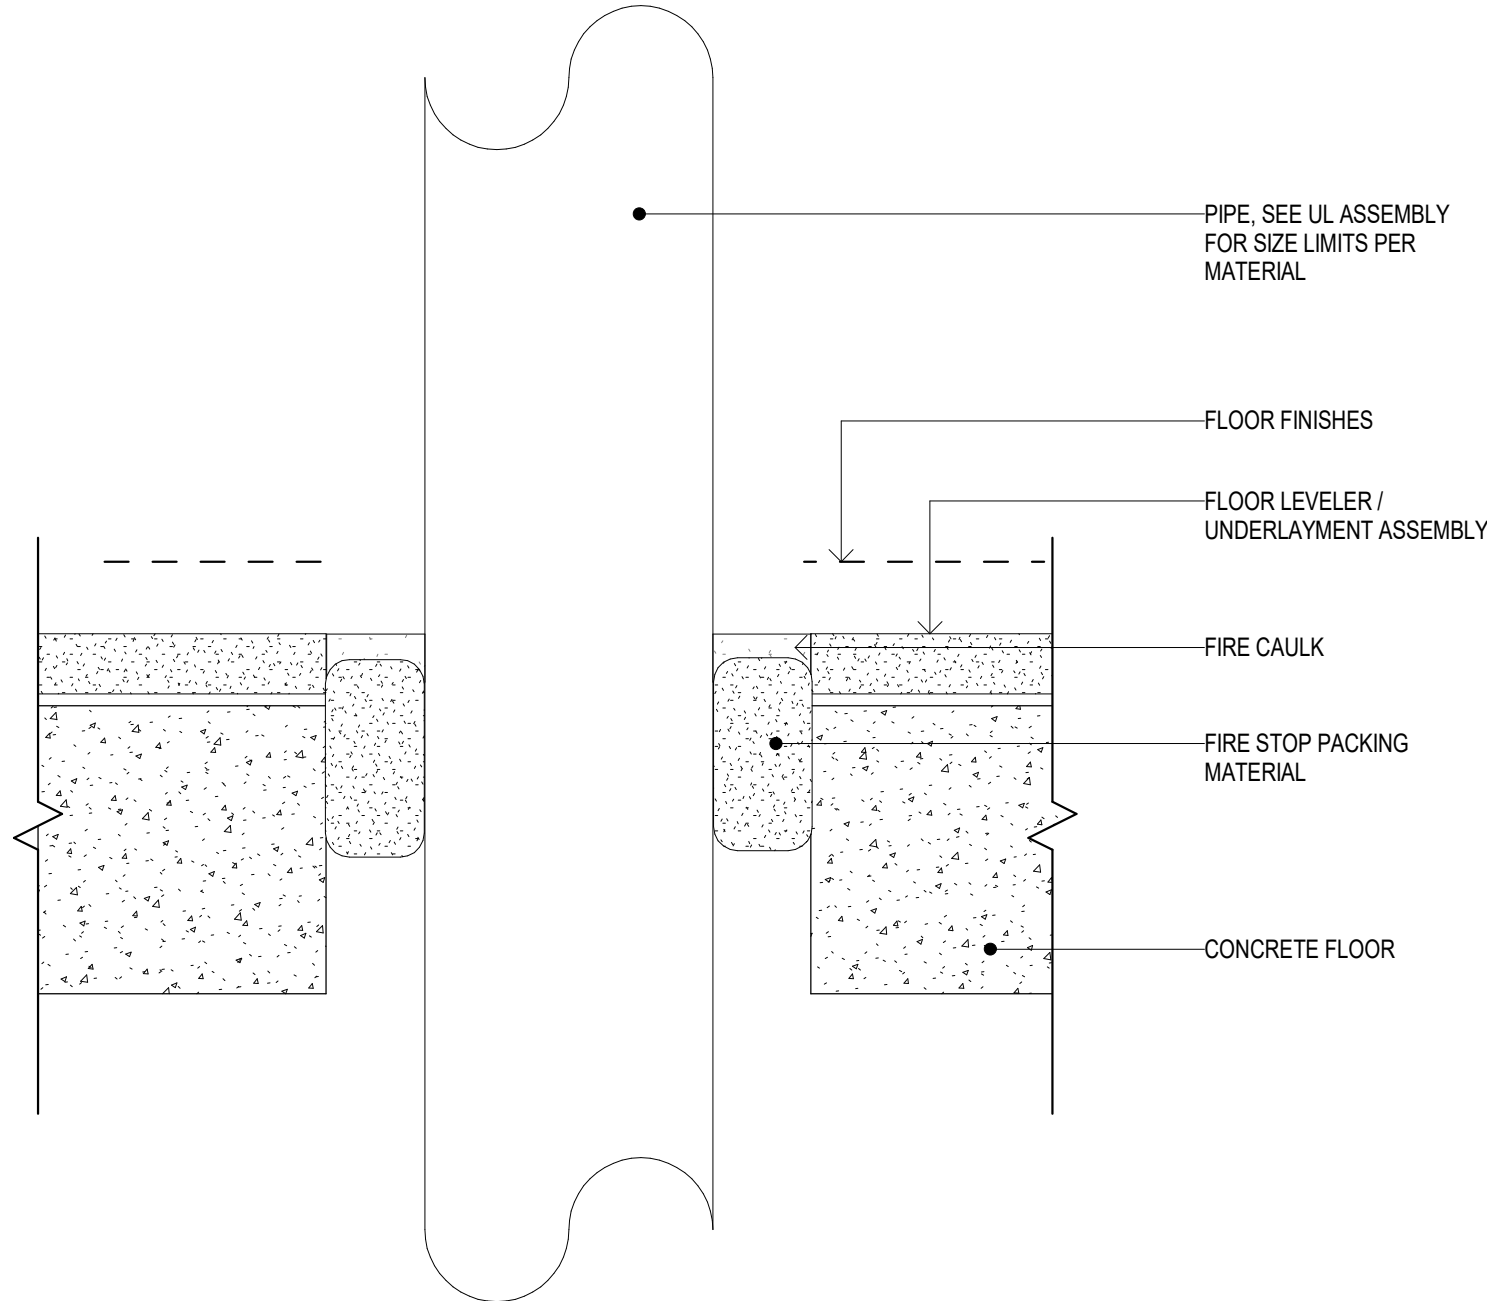

PENETRATION ASSEMBLY # 2

DESCRIPTION: PIPE THRU CONCRETE FLOOR / WALL
FIRE RATING: 1 HR
STC RATING: N/A
REFERENCE: METALIC PIPE: UL# C-AJ-1524
NON METALIC: UL# C-AJ-2066


2 PENETRATION ASSEMBLY 2 - C-AJ-1524
A610 3" = 1'-0"

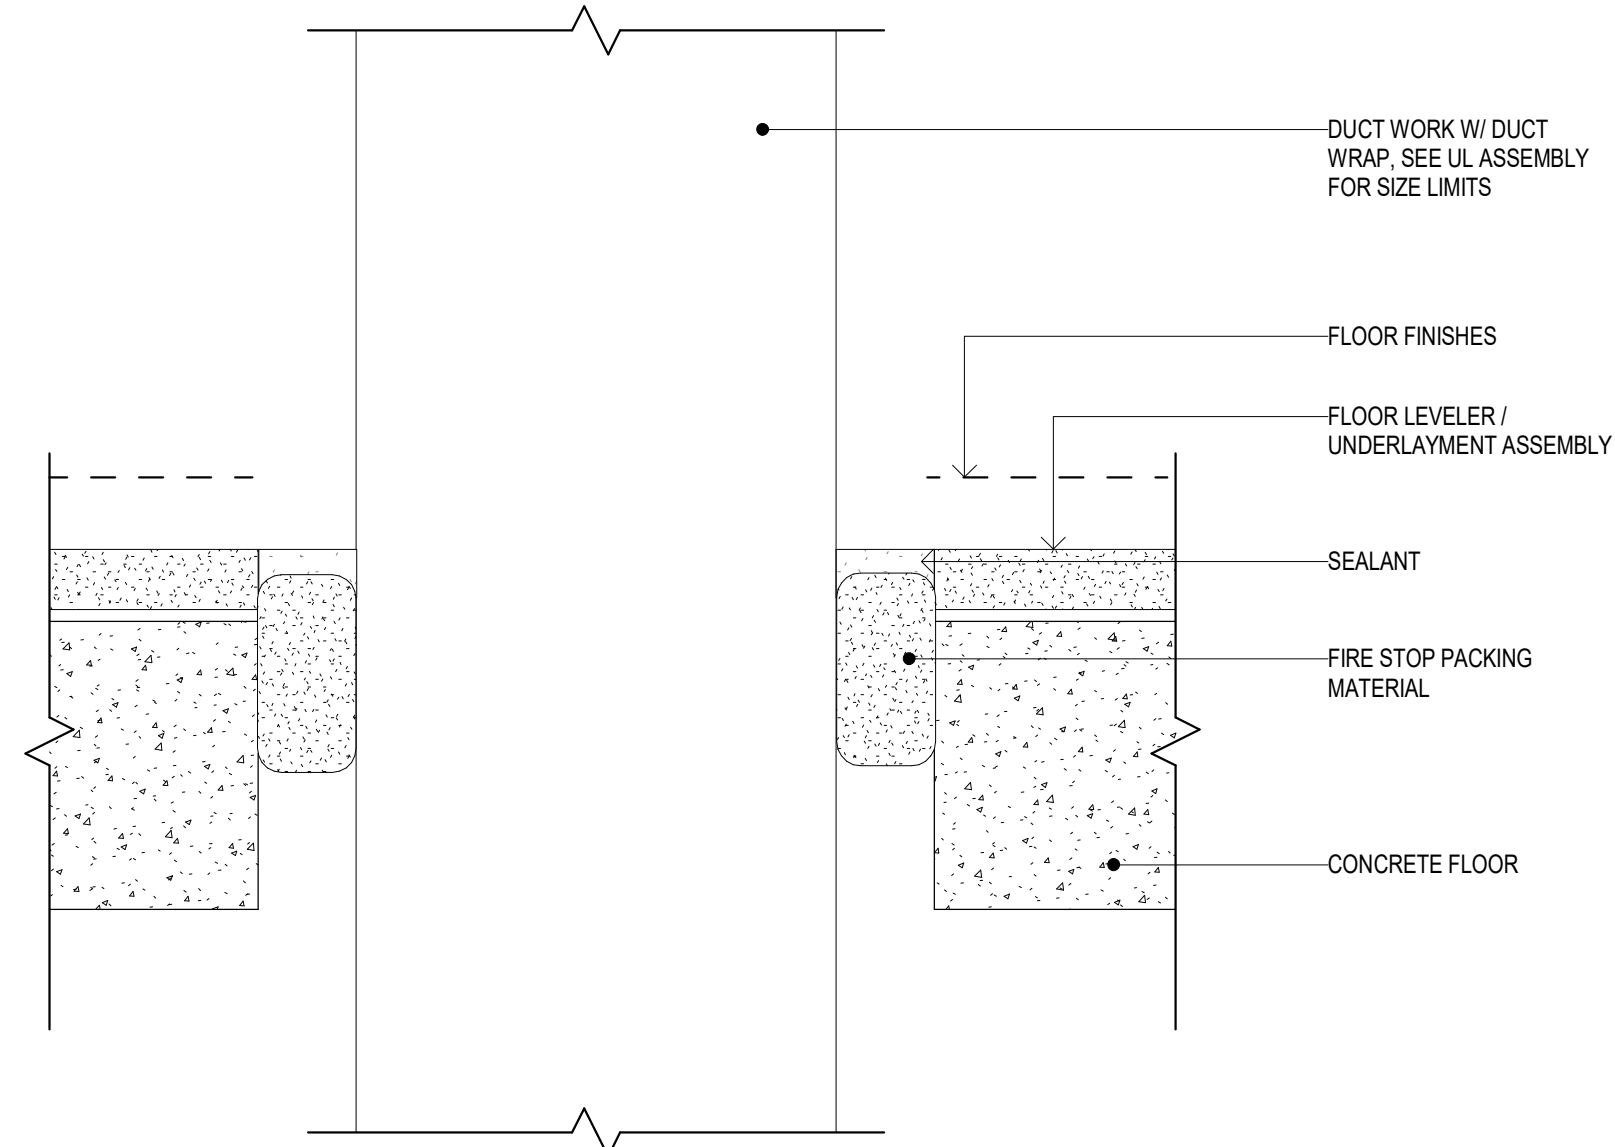

PENETRATION ASSEMBLY # 6

DESCRIPTION: SQUARE DUCT THRU CONCRETE FLOOR / WALL
FIRE RATING: 1HR, 3HR
STC RATING: N/A
REFERENCE: 1HR: UL# C-AJ-7034
3HR: UL# C-AJ-7079


6 PENETRATION ASSEMBLY 6 - C-AJ-7034
A610 3" = 1'-0"

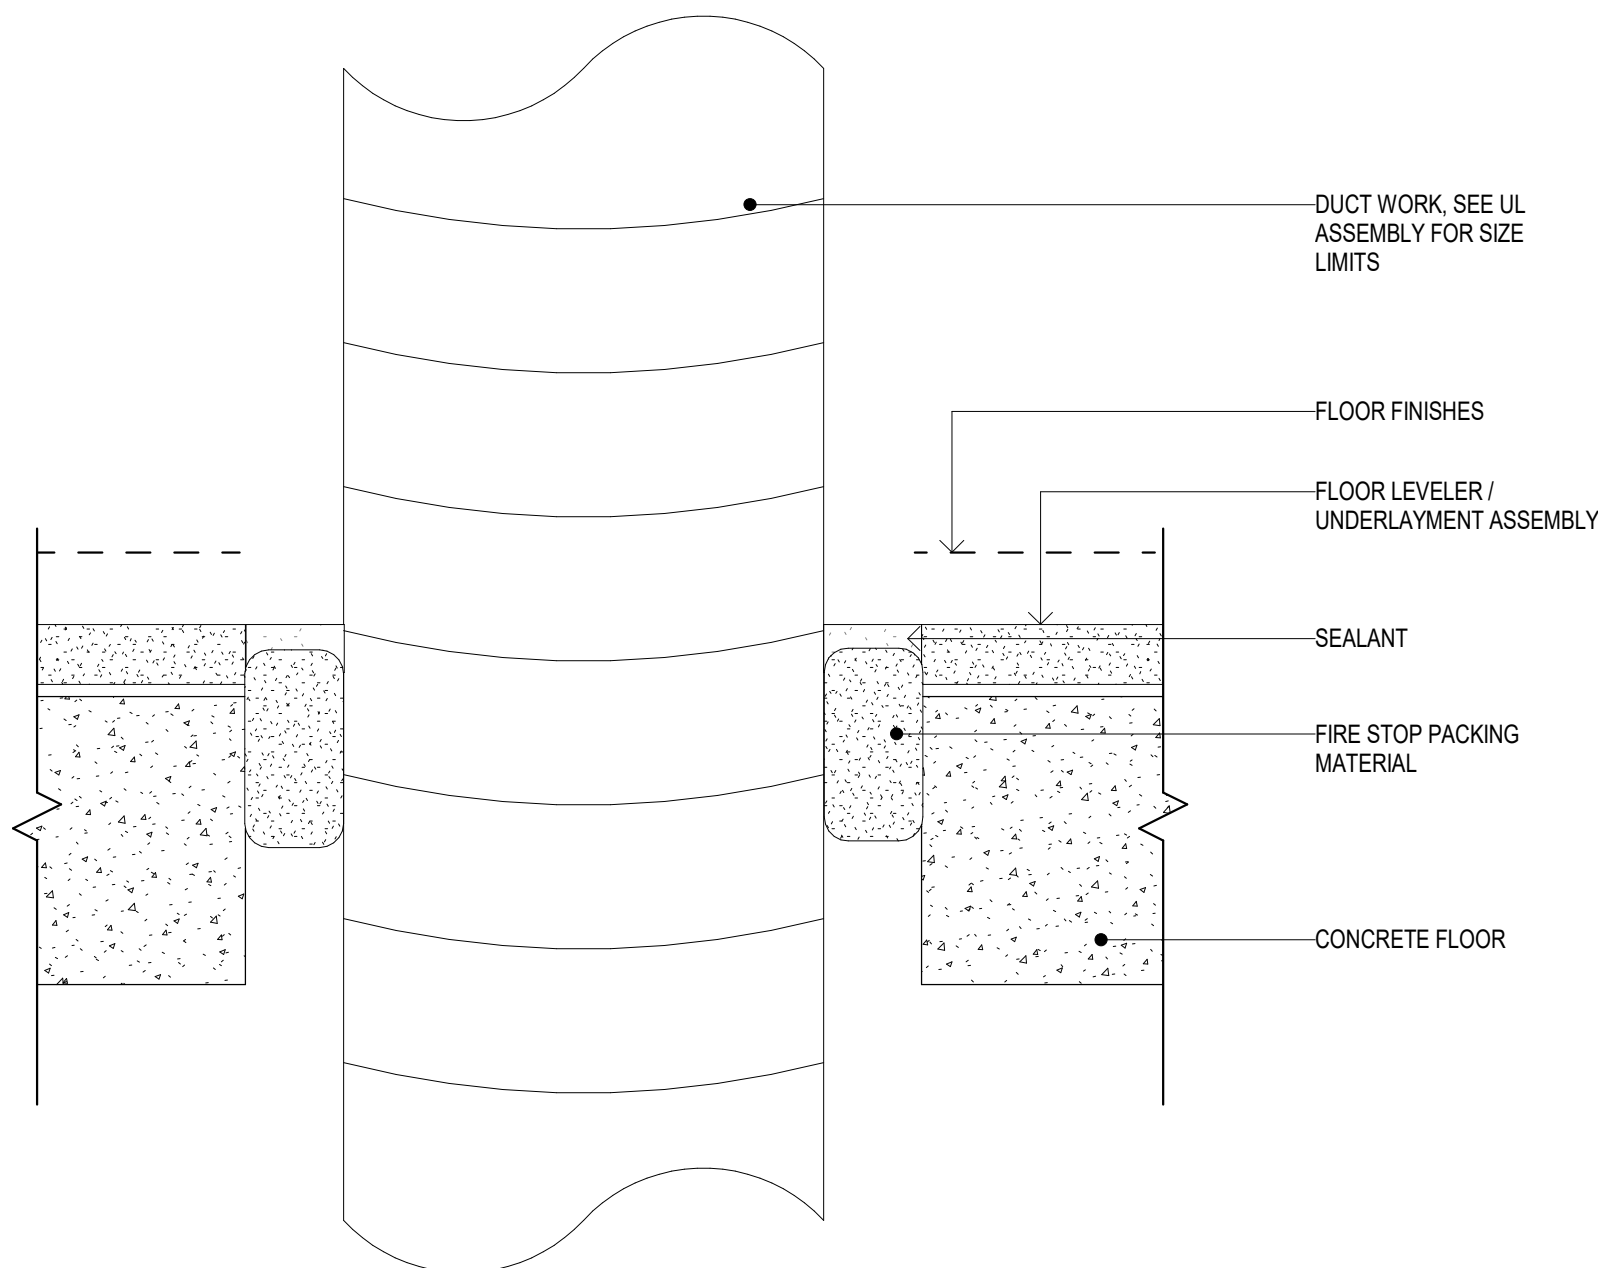

PENETRATION ASSEMBLY # 4

DESCRIPTION: ROUND DUCT THRU CONCRETE FLOOR / WALL
FIRE RATING: 1HR, 3HR
STC RATING: N/A
REFERENCE: 1HR: UL# C-AJ-7039
3HR: UL# C-AJ-7023

4 PENETRATION ASSEMBLY 4 - C-AJ-7039
A610 3" = 1'-0"

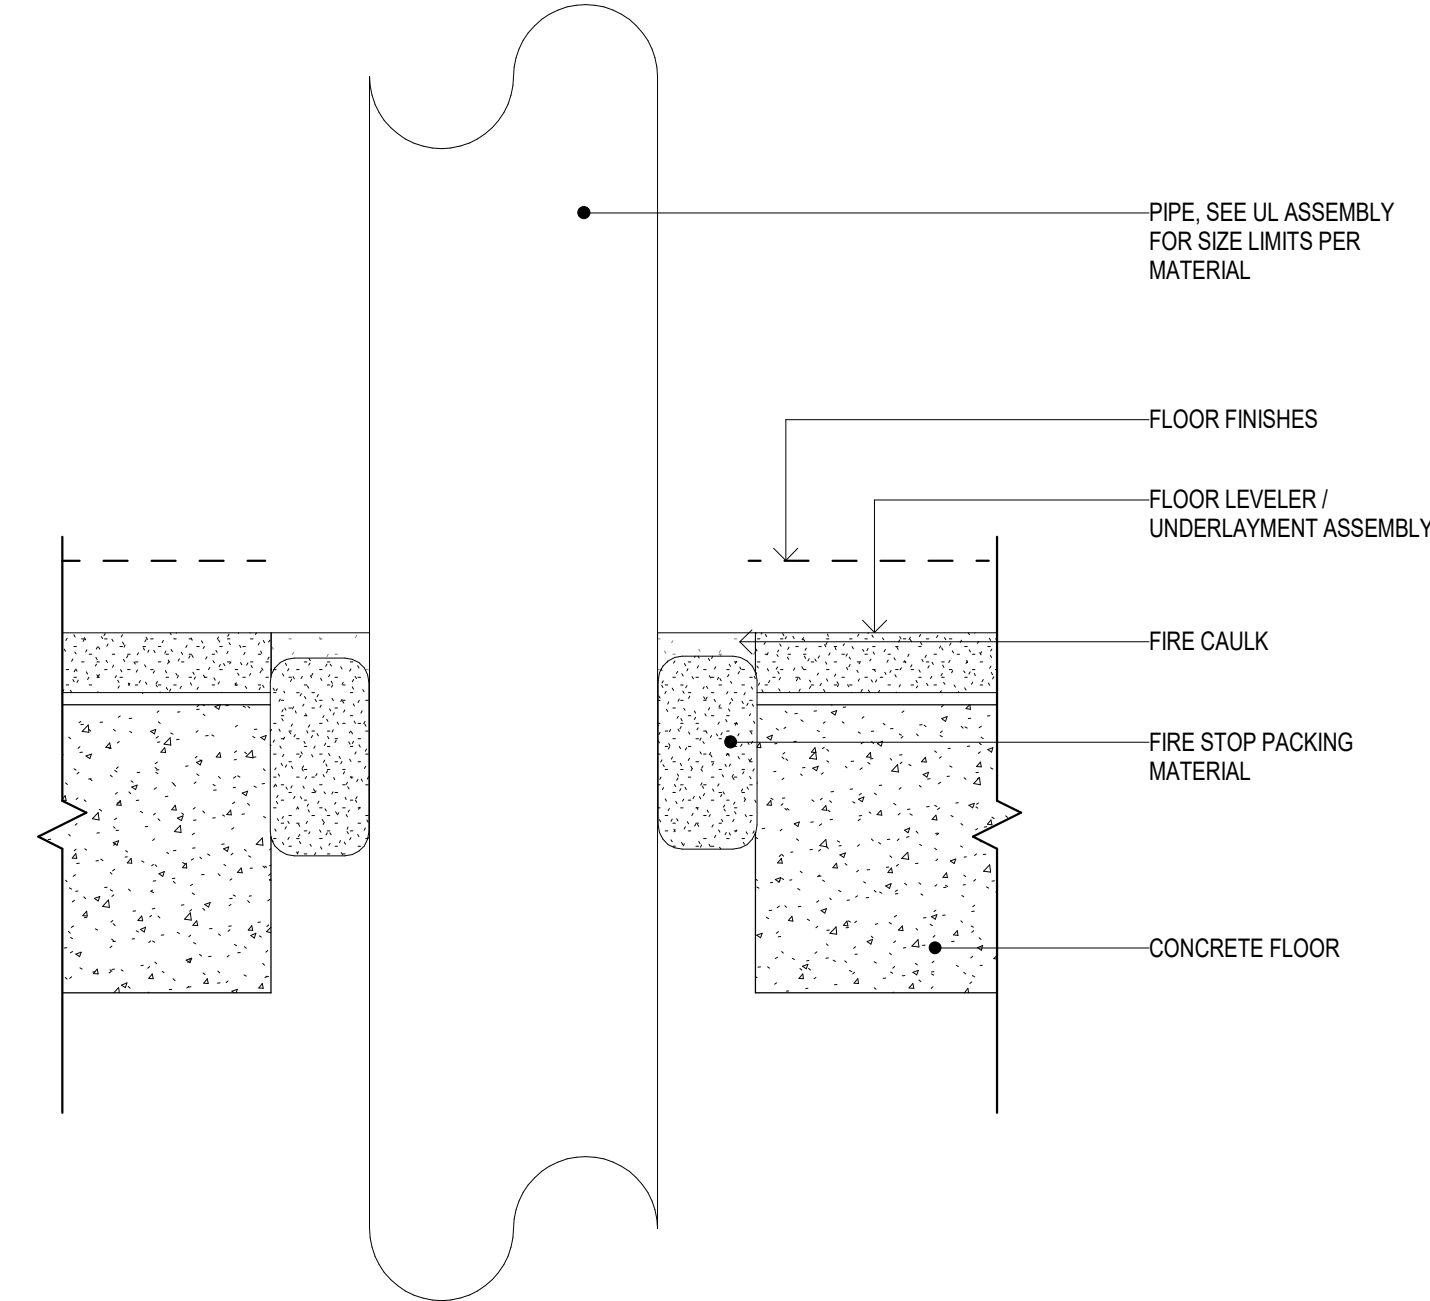

PENETRATION ASSEMBLY # 1

DESCRIPTION: PIPE THRU CONCRETE FLOOR / WALL
FIRE RATING: 3 HR
STC RATING: N/A
REFERENCE: METALIC PIPE: UL# C-AJ-1017
NON METALIC PIPE: UL# C-AJ-2031

1 PENETRATION ASSEMBLY 1 - C-AJ-1017
A610 3" = 1'-0"