

## SEAL

|      |                        |        |
|------|------------------------|--------|
|      |                        |        |
|      |                        |        |
|      |                        |        |
|      |                        |        |
|      |                        |        |
|      |                        |        |
|      |                        |        |
|      |                        |        |
|      |                        |        |
| 2    | Exterior Deck Revision | 2/1/19 |
| MARK | REVISIONS              | DATE   |

ALL DIMENSIONS AND RELATIONSHIPS MUST BE VERIFIED BY CONTRACTOR. THE ARCHITECT IS TO BE NOTIFIED OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE CONSTRUCTION. DO NOT SCALE FROM DRAWINGS.

|            |          |
|------------|----------|
| PROJECT #: | 1351     |
| FILENAME:  |          |
| DRAWN:     | Author   |
| CHECKED:   | Checker  |
| DATE:      | 06/18/18 |


FIRST FLOOR  
FRAMING PLAN

DRAWING

## S2.1

EXTERIOR DECK REVISION  
2/01/19

C:\Revit Local\0411.0046.00 - Struct ON - 2017\_gyanosh.rvt 2/1/2019 4:47:56 PM

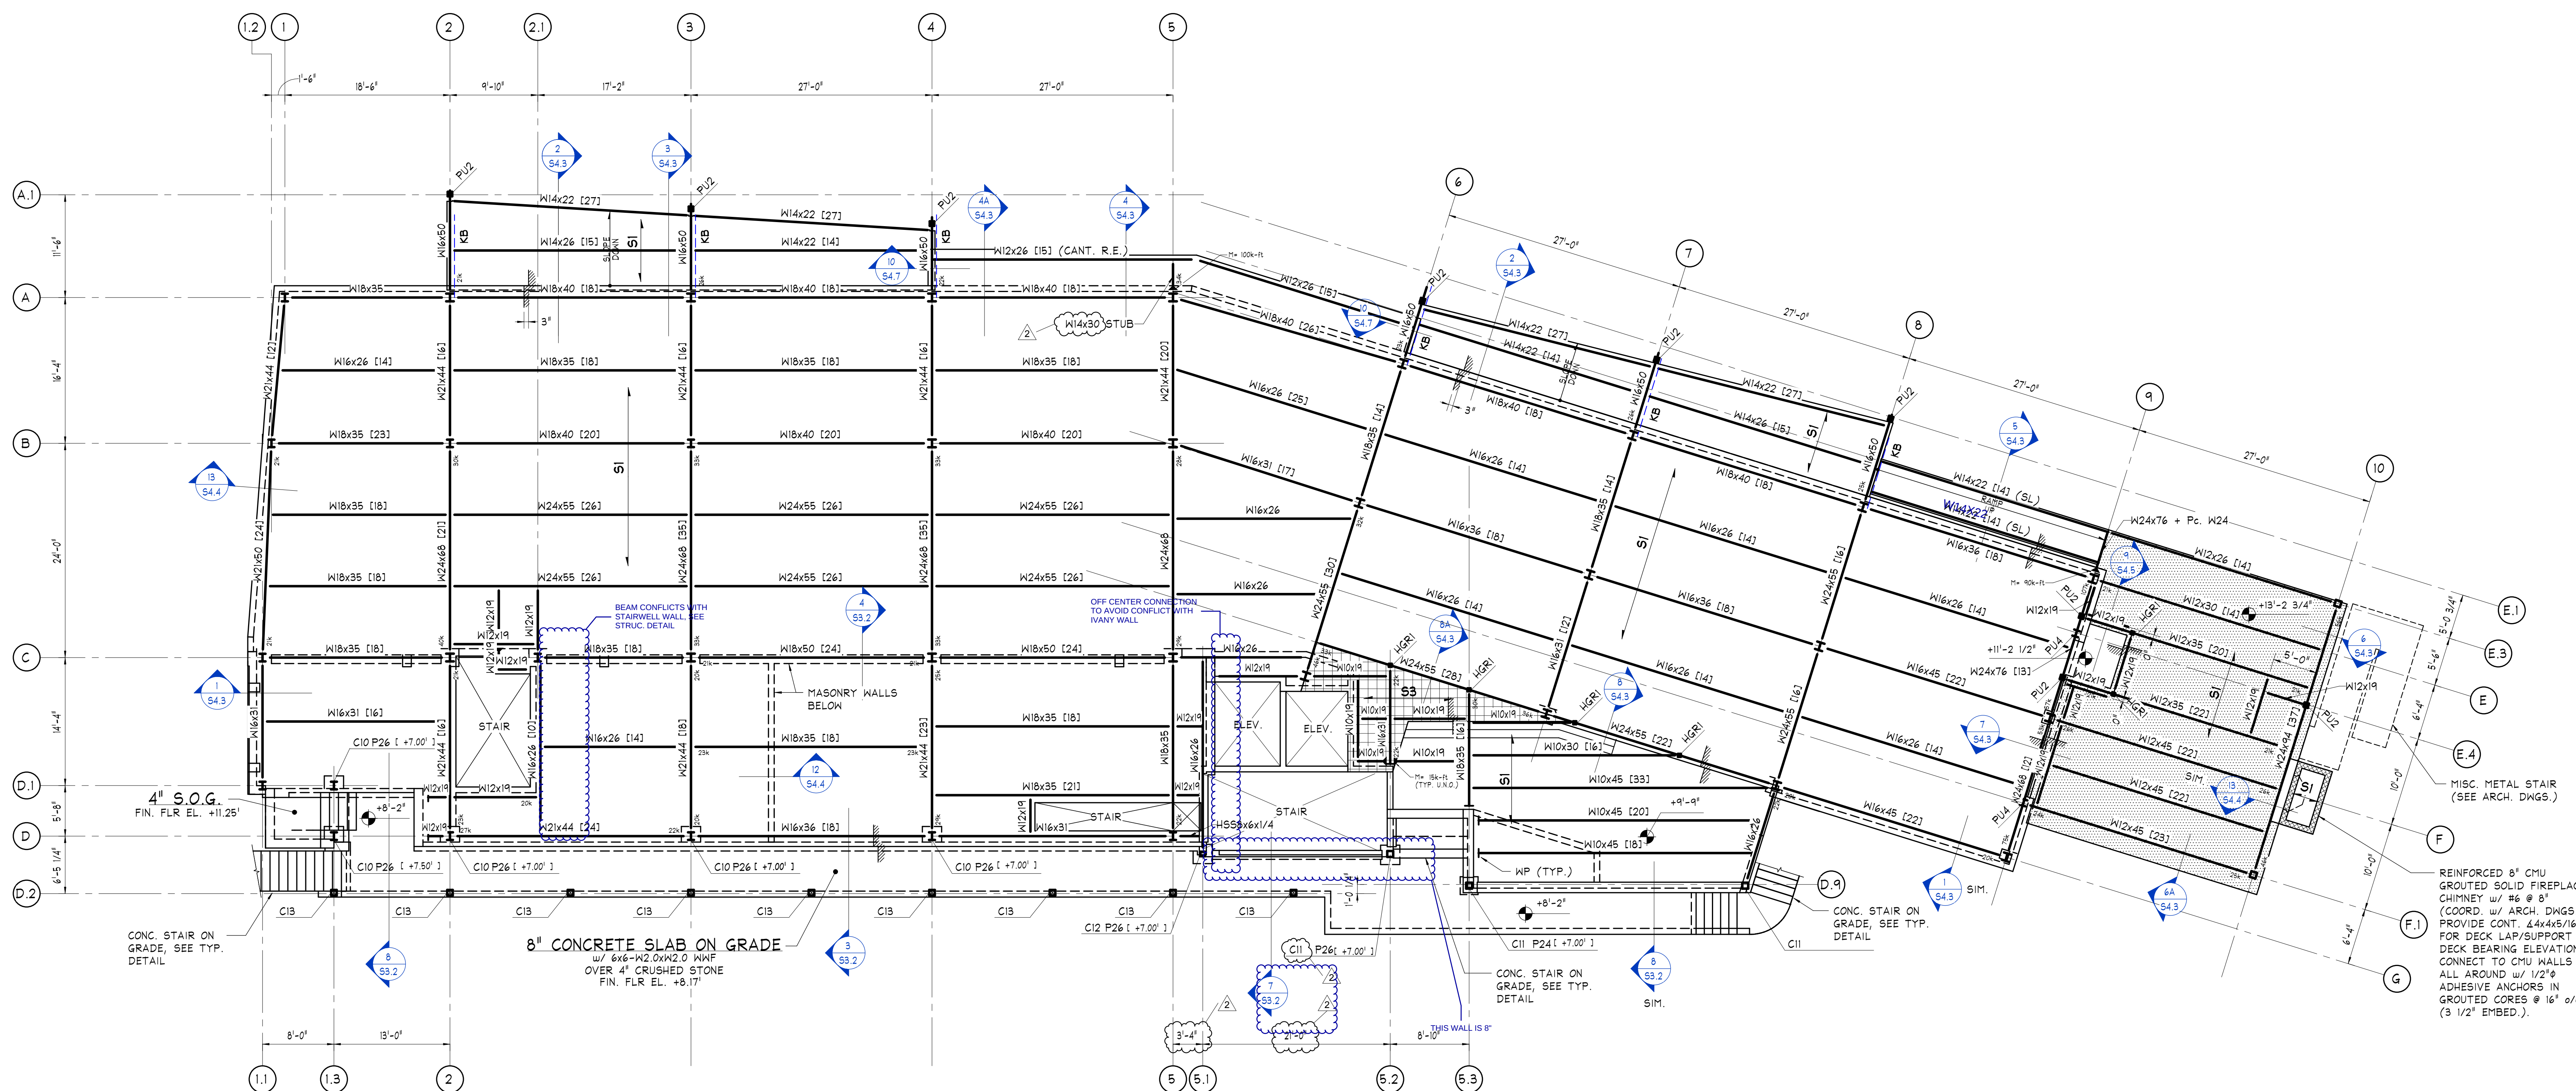

NOTES:

- 1) FINISHED FLOOR ELEVATION +11'-6", FROM DATUM ELEVATION 0'-0", UNLESS NOTED OTHERWISE.
- 2) TOP OF STEEL (DECK BEARING) (~7 1/4") FROM TOP OF SLAB ELEVATION, UNLESS NOTED OTHERWISE.
- 3)  INDICATES 4 1/4" LIGHT WEIGHT CONCRETE w/ 6x6-W2.0 x W2.0 WWF ON 3" 20 GA. (GALV.) LOK-FLOOR COMPOSITE DECK (7 1/4" TOTAL THICKNESS).
- 4)  INDICATES '51' SLAB TYPE w/ RIGID INSULATION USED AS FLOOR FILL ABOVE (SEE GENERAL NOTES FOR ADD'L INFO.). PROVIDE 3" NORMAL-WEIGHT CONCRETE TOPPING SLAB w/ 6x6-W1.4XW1.4 WWF.
- 5) DXXI INDICATES QUANTITY OF 3/4"Ø x 6 1/2" COMPOSITE SHEAR STUDS.
- 6) "C#" INDICATES AMOUNT OF UPWARD CAMBER TO BE PROVIDED.
- 7)  INDICATES MOMENT CONNECTION FOR GRAVITY LOADS, SEE TYPICAL DETAIL.
- 7) PROVIDE FLEXIBLE MOMENT CONNECTION FOR LATERAL LOADS, SEE TYPICAL DETAIL ON 54.0.
- 8) ALL BEAM/GIRDER CONNECTIONS NOT CONNECTED TO COLUMNS SHALL BE DESIGNED FOR A MINIMUM UNFACTORED VERTICAL REACTION OF 20 kips, UNLESS NOTED GREATER. CONNECTIONS TO COLUMNS TO BE PER GENERAL NOTES. ALL RECTIONS SHOWN ON PLAN ARE SERVICE LOADS.
- 9) "PU\_" INDICATES POST-UP, SEE SCHEDULE ON SHEET 50.2.
- 10) "HGR\_" INDICATES HANGER, SEE SCHEDULE ON SHEET 50.2.
- 11) FLOOR STRUCTURE REQUIRES A 3-HOUR FIRE RATING, SEE ARCHITECTURAL DRAWINGS.
- 12) COORDINATE ALL EDGE OF SLAB DIMENSIONS AT SHAFT OPENINGS, BUILDING PERIMETER, ETC., WITH THE ARCHITECTURAL DRAWINGS.
- 13) REFER ARCHITECTURAL DRAWINGS FOR ALL DIMENSIONS. DIMENSIONS SHOWN ON THIS DRAWING ARE FOR CONVENIENCE ONLY, AND MUST BE CHECKED WITH ARCHITECTURAL DRAWINGS FOR ACCURACY. DIMENSIONS ON ARCHITECTURAL DRAWINGS GOVERN.
- 14)  INDICATES APPROXIMATE EXTENT OF 5 1/2" MAX. NORMAL WEIGHT CONCRETE WEARING SLAB w/ 6x6-W2.0 x W2.0 WWF AND WOOD DECKING (SEE ARCH.).
- 15) "+xx.xx'" INDICATES TOP OF PIER ELEVATION RELATIVE TO DATUM ELEVATION 0.00'.
- 16) "WP" INDICATES EMBEDDED PLATE W/ HEADED STUDS DESIGNED FOR 15K LIFTING UNLESS NOTED OTHERWISE ON PLAN. SEE TYPICAL STEEL BEAM TO CAST IN PLACE CONCRETE WALL DETAIL.
- 17) "KB" INDICATES H556x65x18 KNEE BRACE.