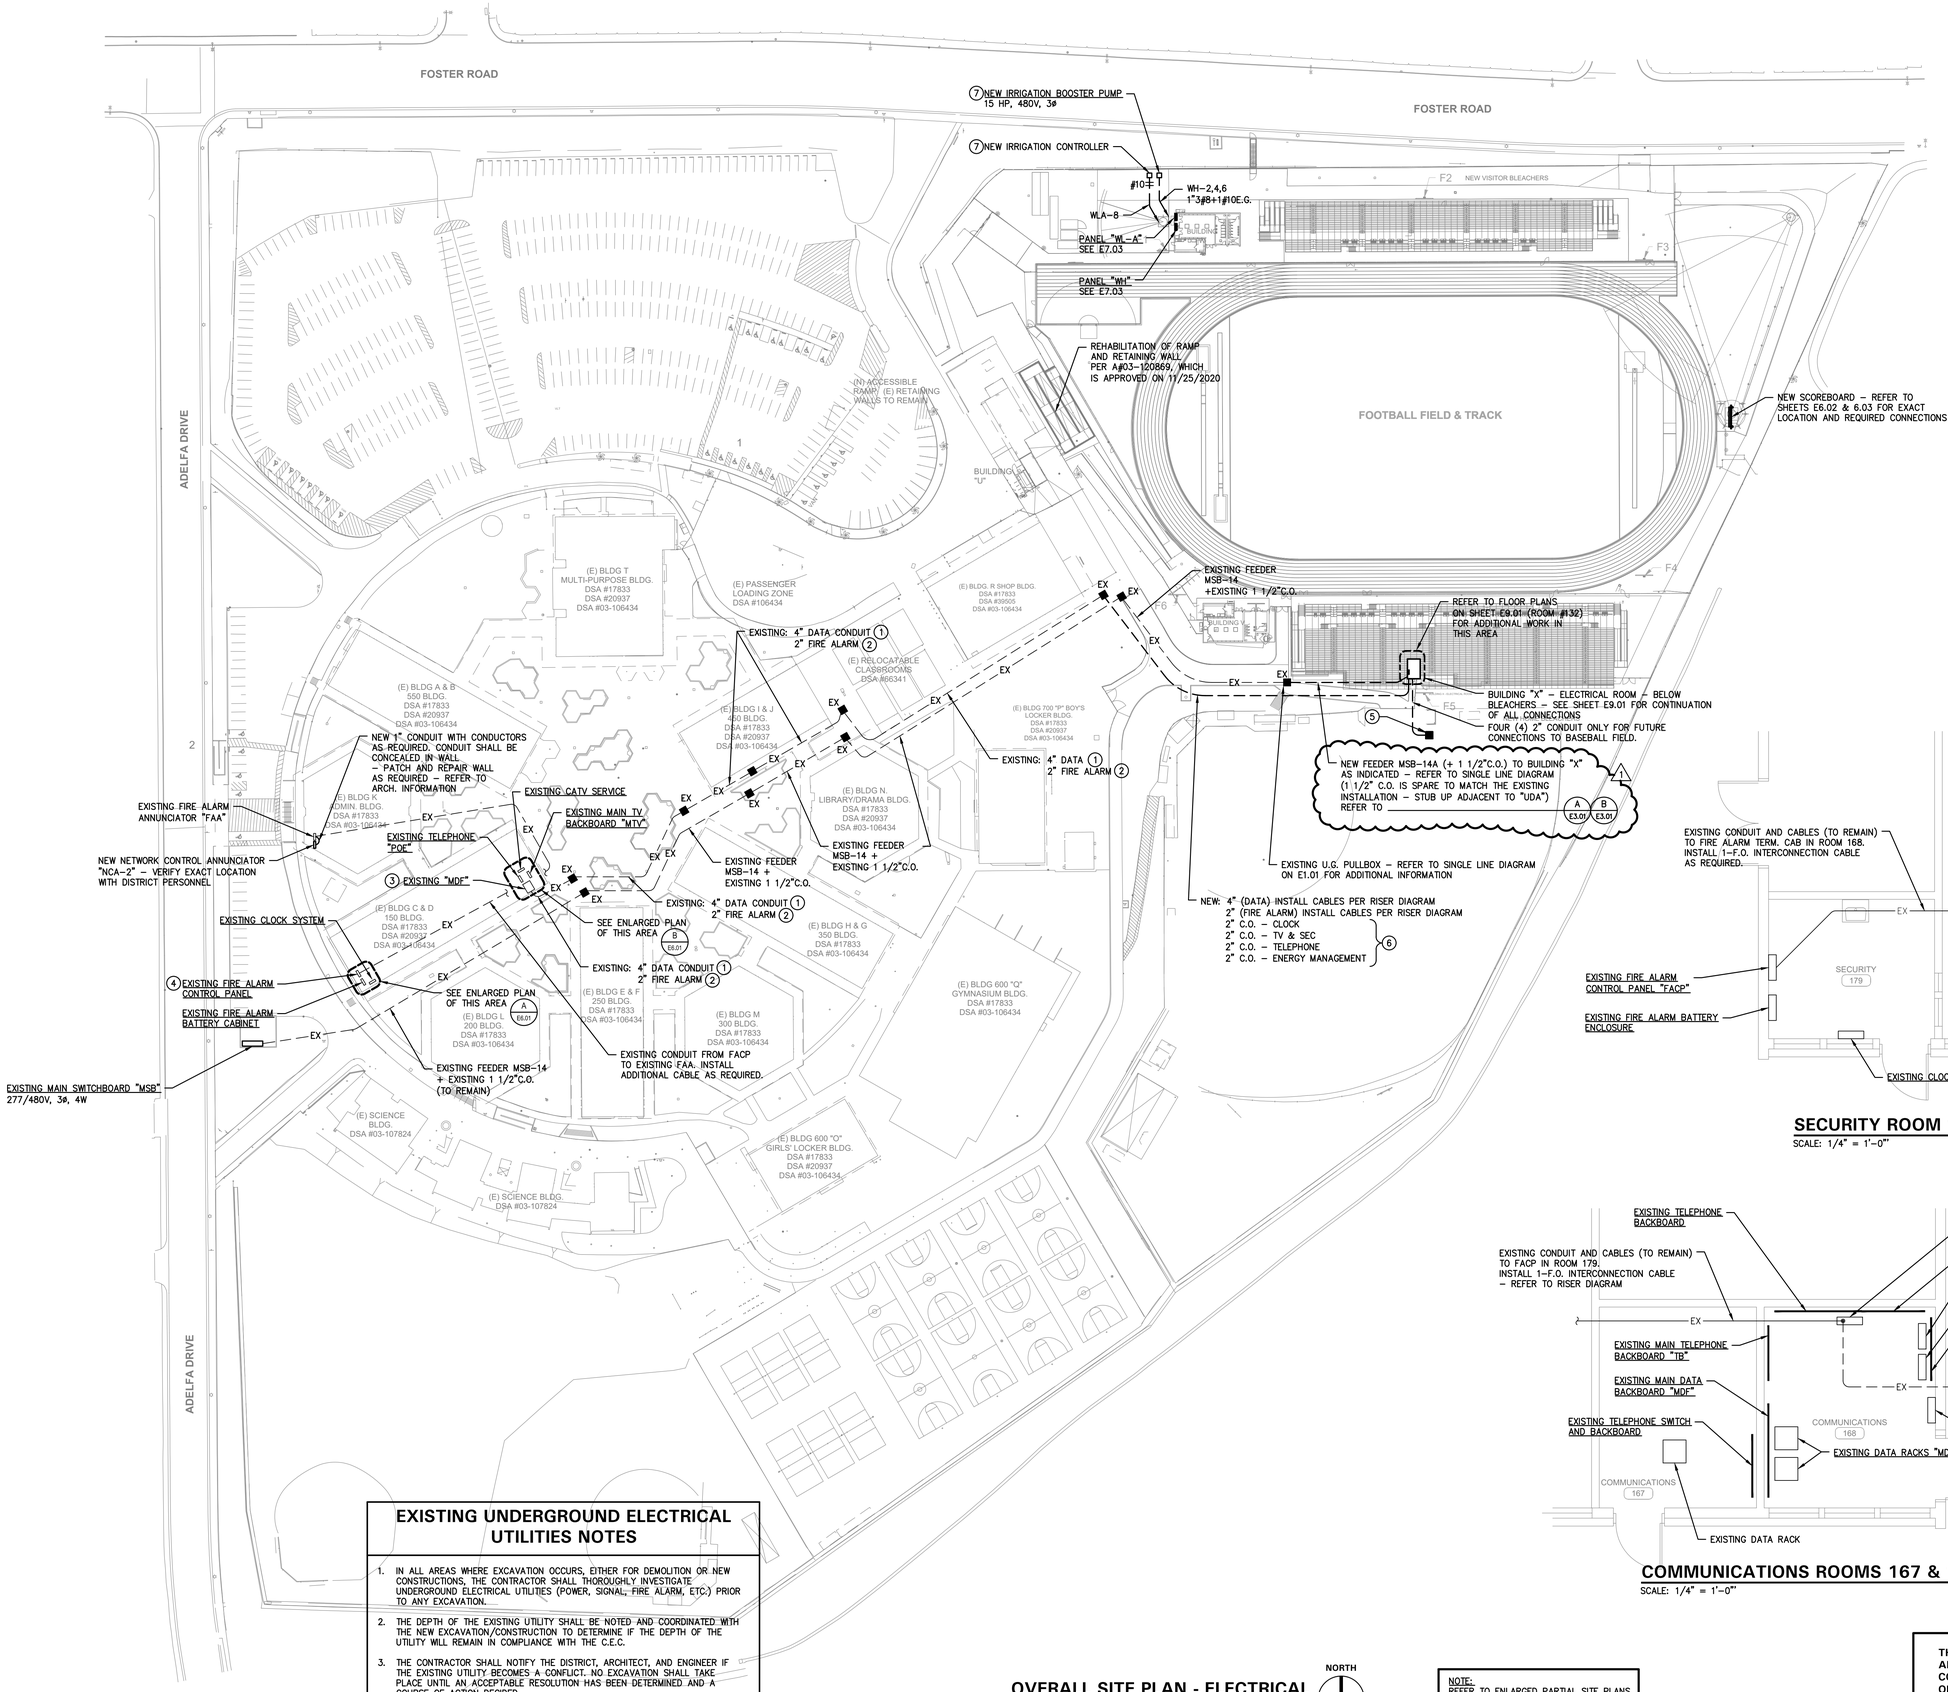

KEYNOTES - THIS SHEET ONLY

1. EXISTING 4" CONDUIT WITH EXISTING DATA CABLES (COPPER AND/OR FIBER OPTIC). INSTALL NEW FIBER OPTIC CABLE PER RISER DIAGRAM TO SERVE NEW IDF IN NEW ELECTRIC ROOM.
2. EXISTING 2" CONDUIT WITH EXISTING FIRE ALARM CABLES TO REMAIN. INSTALL NEW FIRE ALARM CABLES PER THE FIRE ALARM RISER DIAGRAM.
3. EXISTING MDF. PROVIDE NEW FIBER OPTIC INTERFACE AND JUMPER TO CONNECT NEW FIBER OPTIC CABLE TO SERVE NEW IDF IN NEW ELECTRIC ROOM. REFER TO SPECIFICATIONS.
4. EXISTING FIRE ALARM CONTROL PANEL (FACP). PROVIDE NEW FIBER OPTIC INTERFACE AS WELL AS ALL PROGRAMMING TO CONNECT TO NEW SUB-PANEL IN ELECTRIC ROOM. REFER TO FIRE ALARM NOTES C E6.02 REGARDING MAINTENANCE OF SERVICE AND TESTING.
5. NEW 2'x3' IN-GRADE PULLBOX. SEE COORDINATE EXACT LOCATION IN THE FIELD WITH DISTRICT REPRESENTATIVE. (NEAR BASEBALL DUGOUT)
6. SPARE CONDUITS - TO CONTINUE THE EXISTING CONDUIT DISTRIBUTION ESTABLISHED ON THE CAMPUS. THESE CONDUITS ARE CURRENTLY EXTENDED TO ALL OTHER BUILDINGS ON CAMPUS AND THIS WILL MATCH THE EXISTING SCHEME FOR FUTURE FLEXIBILITY.
7. SEE LANDSCAPE DRAWINGS FOR ADDITIONAL INFORMATION AND EXACT LOCATION.

EXISTING UNDERGROUND ELECTRICAL UTILITIES NOTES

1. IN ALL AREAS WHERE EXCAVATION OCCURS, EITHER FOR DEMOLITION OR NEW CONSTRUCTIONS, THE CONTRACTOR SHALL THOROUGHLY INVESTIGATE UNDERGROUND ELECTRICAL UTILITIES (POWER, SIGNAL, FIRE ALARM, ETC.) PRIOR TO ANY EXCAVATION.
2. THE DEPTH OF THE EXISTING UTILITY SHALL BE NOTED AND COORDINATED WITH THE NEW EXCAVATION/CONSTRUCTION TO DETERMINE IF THE DEPTH OF THE UTILITY WILL REMAIN IN COMPLIANCE WITH THE C.E.C.
3. THE CONTRACTOR SHALL NOTIFY THE DISTRICT, ARCHITECT, AND ENGINEER IF THE EXISTING UTILITY BECOMES A CONFLICT. NO EXCAVATION SHALL TAKE PLACE UNTIL AN ACCEPTABLE RESOLUTION HAS BEEN DETERMINED AND A COURSE OF ACTION DECIDED.

OVERALL SITE PLAN - ELECTRICAL

SCALE: 1" = 60'

NORTH

SECURITY ROOM 179

SCALE: 1/4" = 1'-0" (A / E6.01)

COMMUNICATIONS ROOMS 167 & 168

SCALE: 1/4" = 1'-0" (B / E6.01)

NOTE:
REFER TO ENLARGED PARTIAL SITE PLANS ON SHEETS E6.02 AND E6.03 FOR ADDITIONAL WORK.

THIS APPROVAL IS FOR ITEMS WITHIN CLOUDED AREAS ONLY. FOR OTHER INFORMATION NOT CONTAINED WITHIN CLOUDED AREAS, REFER TO ORIGINAL DSA APPROVED PLANS.

DO NOT USE THESE PLANS AS SUBSTITUTE FOR THE ORIGINAL DSA APPROVED PLANS

3/2/2020 1:48:18 PM D:_Revit\161-19015-LaMiradaAthleticField_ARCH_jblee.rvt

© 2015 NAC Inc.

REVISIONS

1 ADDENDUM 1	02/01/2022

REGISTERED PROFESSIONAL ENGINEER ANTONIO BERNARDO LAZARO No. E18532 EXP 9-30-22 ELECTRICAL BEGGAY/KIM STATE OF CALIFORNIA

19098.MDD
TURPIN & RATTAN
CONSULTING ENGINEERS
ENGINEERING, INC.
3441 HONOLULU AVENUE, SUITE 200
MONTROSE, CA 91020
818/249/0444 FAX 249/1467

NORWALK LA MIRADA UNIFIED SCHOOL DISTRICT

LA MIRADA HIGH SCHOOL NEW FOOTBALL STADIUM PROJECT

13520 ADELFA DRIVE, LA MIRADA, CA, 90638

DSA # 03-120551

NAC ARCHITECTURE
NAC NO. 161-19015
DATE 02/01/2022

ADDENDUM 1

OVERALL SITE PLAN - ELECTRICAL

E6.01