


FIELDHOUSE (VISITOR) FLOOR PLAN - LIGHTING

SCALE: 1/4" = 1'-0"




KEY NOTES - THIS SHEET ONLY

- REFER TO MECHANICAL CONTROL DIAGRAMS (M0.03 & M0.04) FOR CABLE/CONDUCTOR REQUIREMENTS.
- LOCATE TRANE BAGNET INTERFACE, NETWORK LINK AND CONTROL PANEL IN IDF/LDF CABINET - COORDINATE LOCATION IN THE FIELD WITH CONTROLS CONTRACTOR.
- CIRCUIT FOR EXTERIOR LIGHTING SHALL BE CONNECTED TO A NEW RELAY LOCATED ADJACENT TO PANEL "WH". NEW RELAY SHALL BE CONTROLLED BY THE "AUTOMATED LOGIC CORPORATION" CONTROL SYSTEM.
- TO LDF-W. CONNECT TO NEW "ALC" CONTROLS. COORDINATE CABLE/CONDUCTORS REQUIRED WITH CONTROL CONTRACTOR.

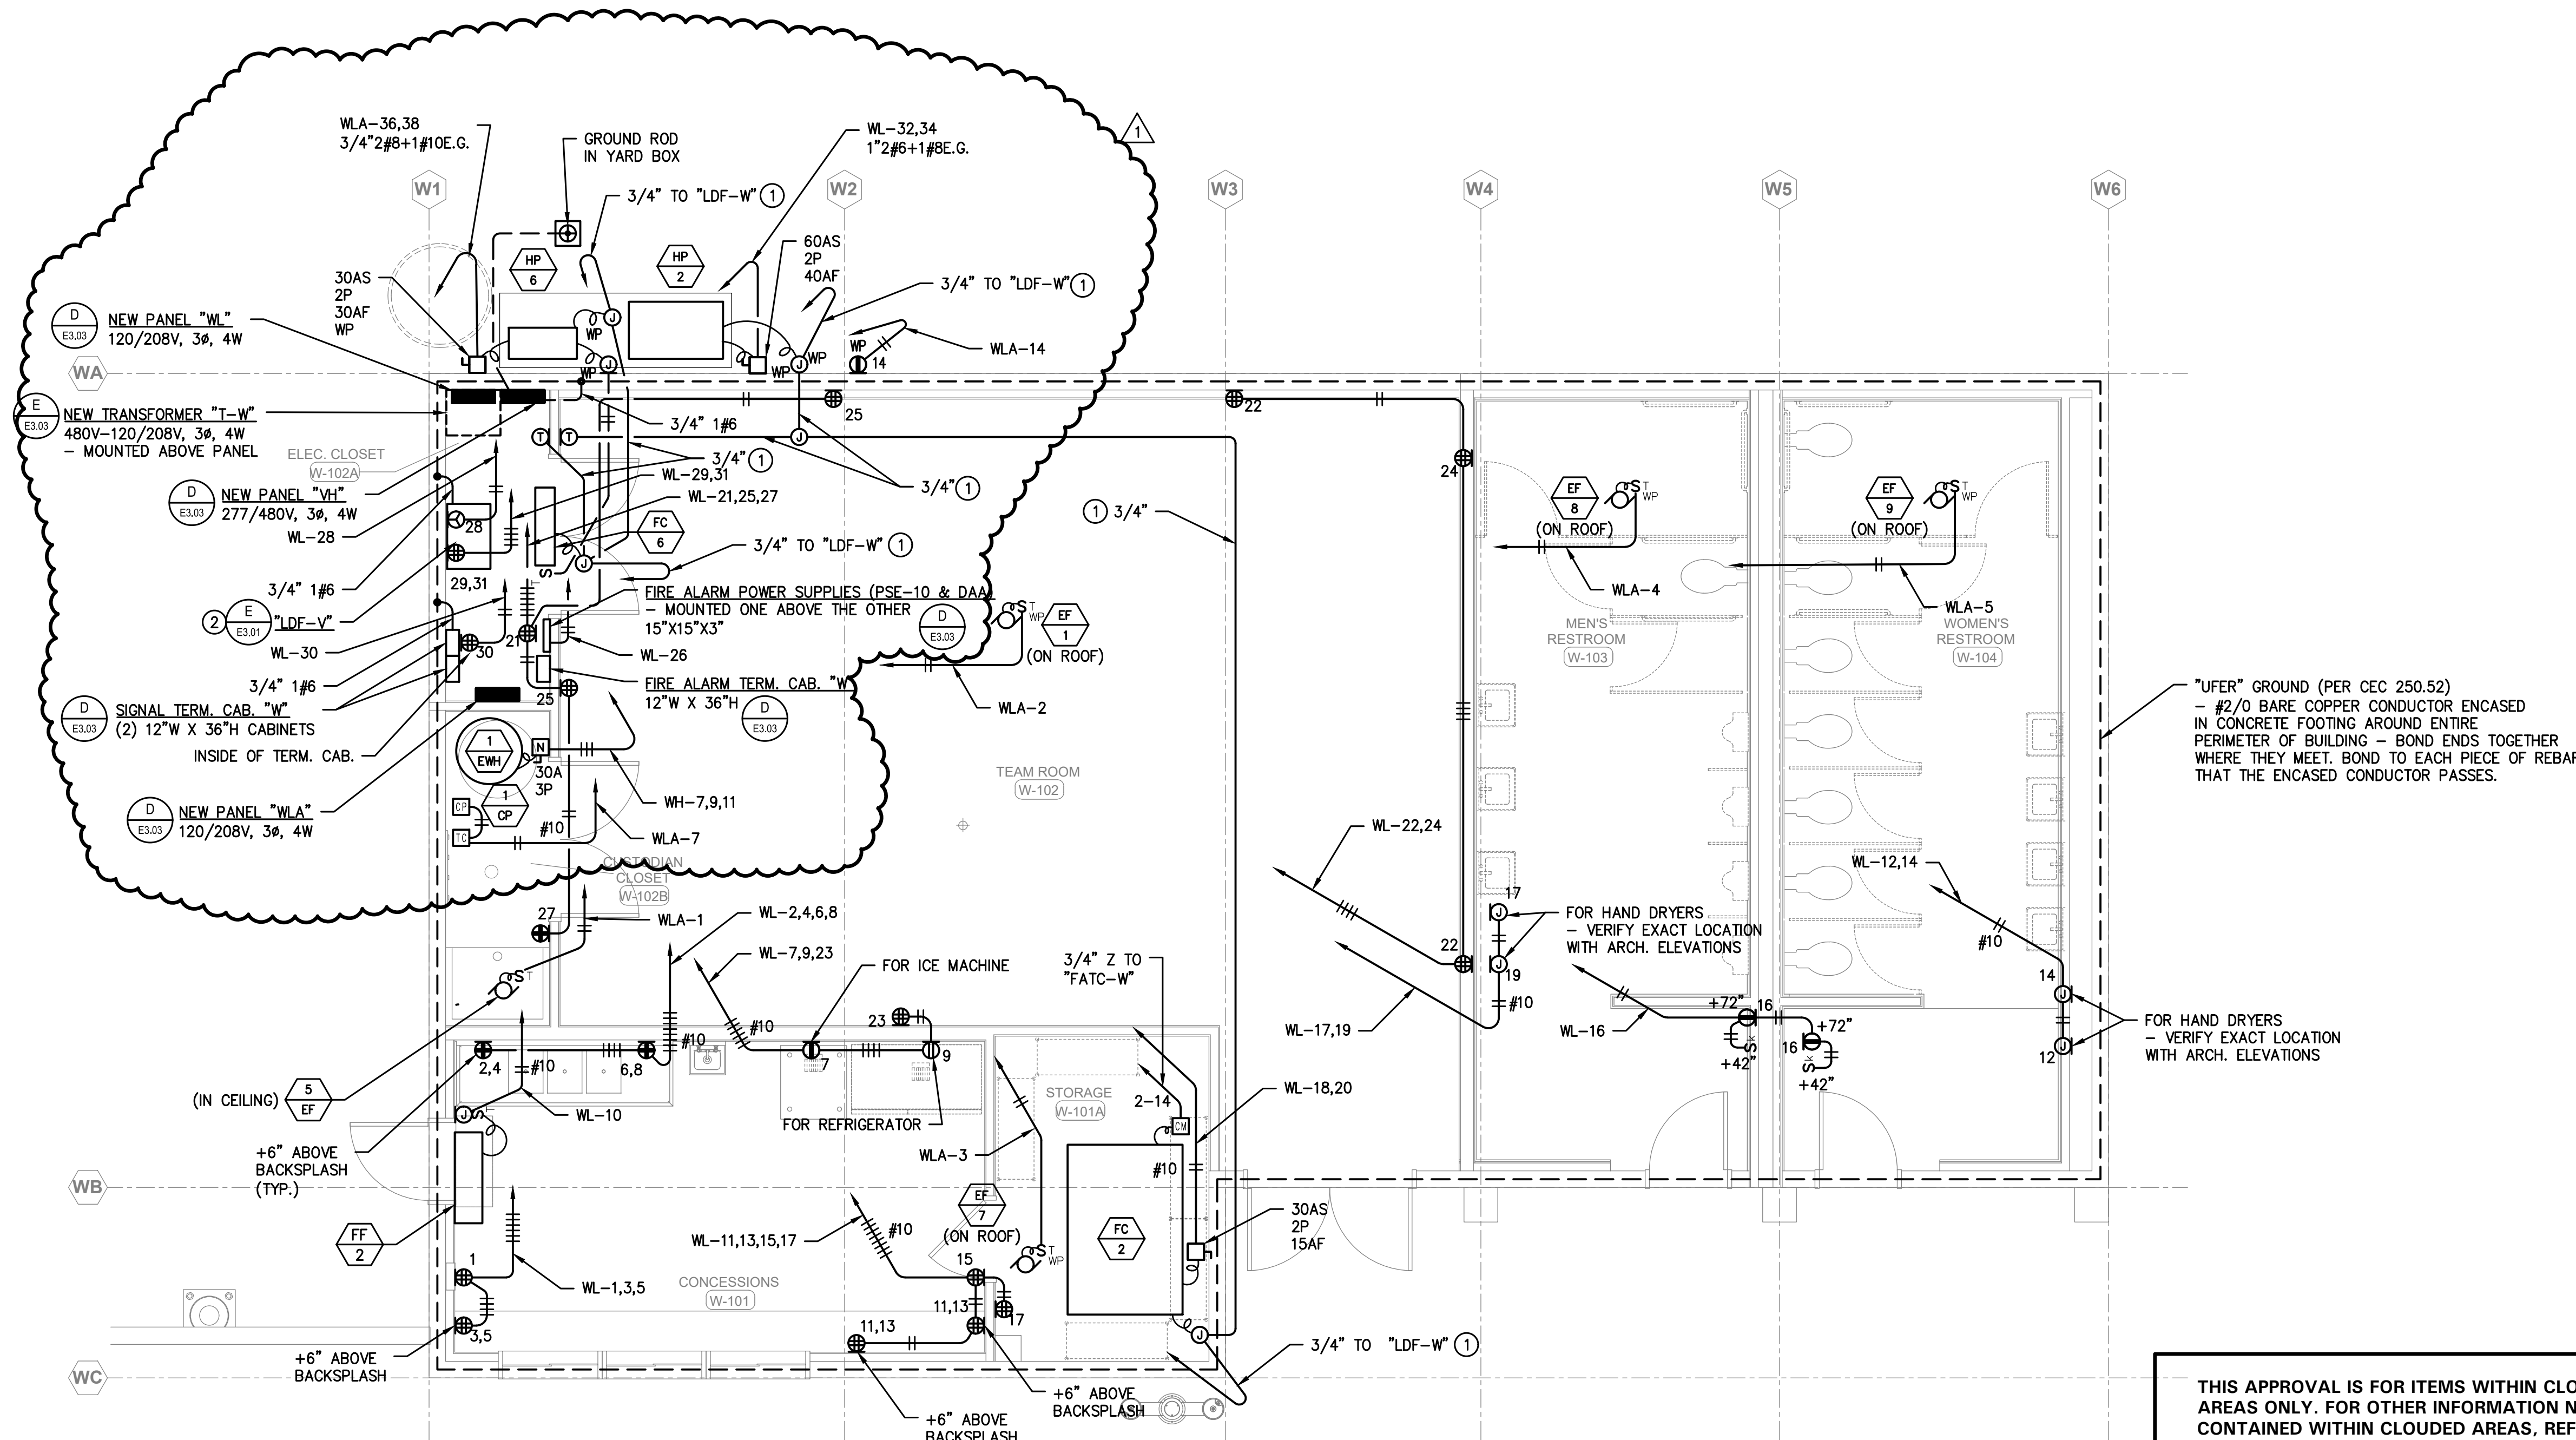

FIELDHOUSE (VISITOR) FLOOR PLAN - POWER

SCALE: 1/4" = 1'-0"



THIS APPROVAL IS FOR ITEMS WITHIN CLOUDED AREAS ONLY. FOR OTHER INFORMATION NOT CONTAINED WITHIN CLOUDED AREAS, REFER TO ORIGINAL DSA APPROVED PLANS.

DO NOT USE THESE PLANS AS SUBSTITUTE FOR THE ORIGINAL DSA APPROVED PLANS



1909B.MOD
TURPIN & RATTAN
ENGINEERING, INC.
CONSULTING ENGINEERS
10000 DEL MAR BLVD., SUITE 200
DANA POINT, CA 92629-1487
P 949.449.1487
F 949.449.1487

NORWALK LA MIRADA UNIFIED SCHOOL DISTRICT
LA MIRADA HIGH SCHOOL NEW FOOTBALL STADIUM PROJECT
13520 ADELA DRIVE, LA MIRADA, CA 90638

DSA # 03-120551

NAC
ARCHITECTURE

NAC NO. 161-19015
DATE 02/01/2022

ADDENDUM 1

FLOOR PLANS
BUILDING "W" -
LIGHTING & POWER

E7.03