

NOTE:
REFER TO SPECIFICATIONS FOR FURTHER INFORMATION.

13 ISA SIGN AT PARKING STALL
Scale: 1/2" = 1'-0"

11b ACCESSIBLE PARKING SIGN
Scale: 1 1/2" = 1'-0"

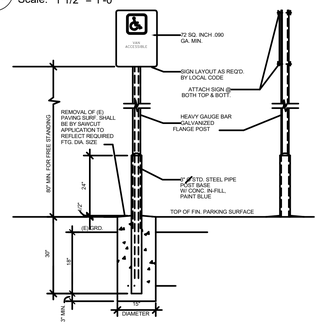

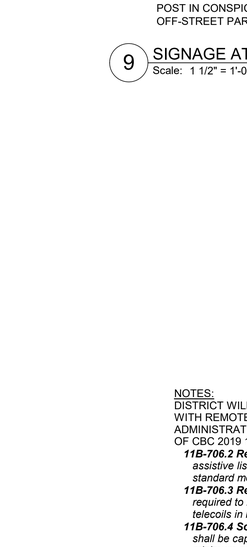

11a VAN ACCESSIBLE PARKING SIGN
Scale: 1 1/2" = 1'-0"

10 POST MTD. ACCESSIBLE PARKING SIGN
Scale: 1/2" = 1'-0"

NOTE:
POST IN CONSPICUOUS PLACE AT ENTRANCE TO OFF-STREET PARKING LOT. SEE LOCATION ON 6-G1.01

9 SIGNAGE AT PARKING LOT ENTRANCE
Scale: 1 1/2" = 1'-0"

NOTES:
DISTRICT WILL PROVIDE A PERMANENT ASSISTIVE LISTENING SYSTEM WITH REMOTE DEVICES. SYSTEM WILL BE AVAILABLE AT THE ADMINISTRATION OFFICE AND SHALL COMPLY WITH THE REQUIREMENTS OF CBC 2019 11B-706 AS LISTED BELOW:

***11B-706.2 Receiver jacks**. Receivers required for use with an assistive listening system shall include a 1/8 inch (3.2 mm) standard mono jack.*

***11B-706.3 Receiver hearing-aid compatibility**. Receivers required to be hearing-aid compatible shall interface with telecoils in hearing aids through the provision of neckloops.*

***11B-706.4 Sound pressure level**. Assistive listening systems shall be capable of providing a sound pressure level of 110 dB minimum and 118 dB maximum with a dynamic range on the volume control of 50 dB.*

***11B-706.5 Signal-to-noise ratio.** The signal-to-noise ratio for internally generated noise in assistive listening systems shall be 18 dB minimum.*

***11B-706.6 Peak clipping level.** Peak clipping shall not exceed 18 dB of clipping relative to the peaks of speech.*

OWNER SHALL PROVIDE RECEIVERS. THE QUANTITY SHALL BE EQUAL TO 4 PERCENT OF THE TOTAL NUMBER OF SEATS BUT NEVER LESS THAN 2. 25 PERCENT OF THE NUMBER OF RECEIVERS PROVIDED, BUT NOT LESS THAN 2, SHALL BE HEARING AID COMPATIBLE.

FINAL DESIGN OF THE SIGN TO BE PROVIDED BY ARCHITECT

VISUAL CHARACTERS SHALL COMPLY WITH CBC 11B-703.5

8 ASSISTIVE LISTENING SYSTEM
Scale: 3" = 1'-0"

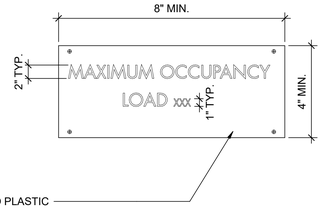

1/4" THICK LAMINATED PLASTIC
UPPER LAYER:
1/8" THICK NON-GLARE CLEAR ACRYLIC
LOWER LAYER:
1/8" THICK OPAQUE ACRYLIC
POLISHED EDGES, SUB-SURFACEAPPLICATION

GENERAL NOTE:
CONFORM TO SECTION 1004.3, CALIFORNIA BUILDING CODE.

NOTE:
REFER TO SPEC 10 1400 - 2.3 - B AND CBC 2016 11B-703.5 FOR REQUIREMENTS FOR VISUAL CHARACTER SIGNS

7 MAX. OCCUPANCY LOAD ('O') (VISUAL SIGN)
Scale: 3" = 1'-0"



NOTE:
REFER TO SPEC 10 1400 - 2.3 - B AND CBC 2016 11B-703.5 FOR REQUIREMENTS FOR VISUAL CHARACTER SIGNS

6 ROOF ACCESS SIGN (VISUAL SIGN)
Scale: 3" = 1'-0"

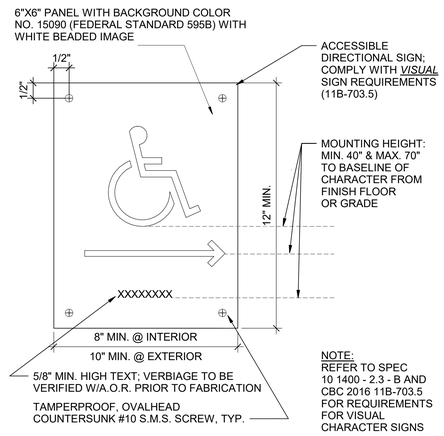

5 ACCESSIBLE DIRECTIONAL SIGNAGE (VISUAL SIGN)
Scale: 6" = 1'-0"

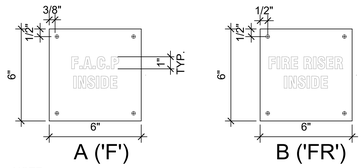

NOTE:
REFER TO SPEC 10 1400 - 2.3 - B AND CBC 2016 11B-703.5 FOR REQUIREMENTS FOR VISUAL CHARACTER SIGNS

4 FIRE SIGNAGE (VISUAL SIGN)
Scale: 3" = 1'-0"

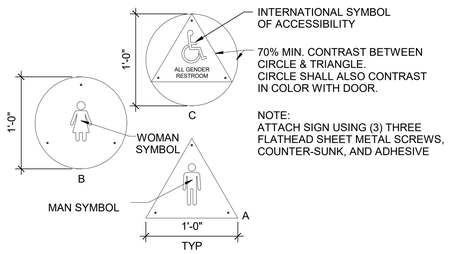

3 RESTROOM DOOR SIGNS (NON-TACTILE)
Scale: 1 1/2" = 1'-0"

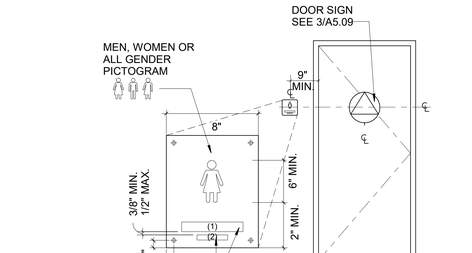

RAISED CHARACTER (1) & BRAILLE (2) ON RESTROOM IDENTIFICATION SIGN: COMPLY WITH *TACTILE* SIGN REQUIREMENTS (12/-) & *VISUAL* SIGN REQUIREMENTS (11B-703.5); BOTH RAISED CHARACTERS AND BRAILLE SHALL BE CENTERED ON THE SIGN TO ENSURE 18"x18" CLEAR APPROACH AREA IS MAINTAINED.

NOTE:
SEE A7.02 MOUNTING HEIGHTS.

2 RESTROOM SIGNAGE ELEVATION
Scale: 1/2" = 1'-0"

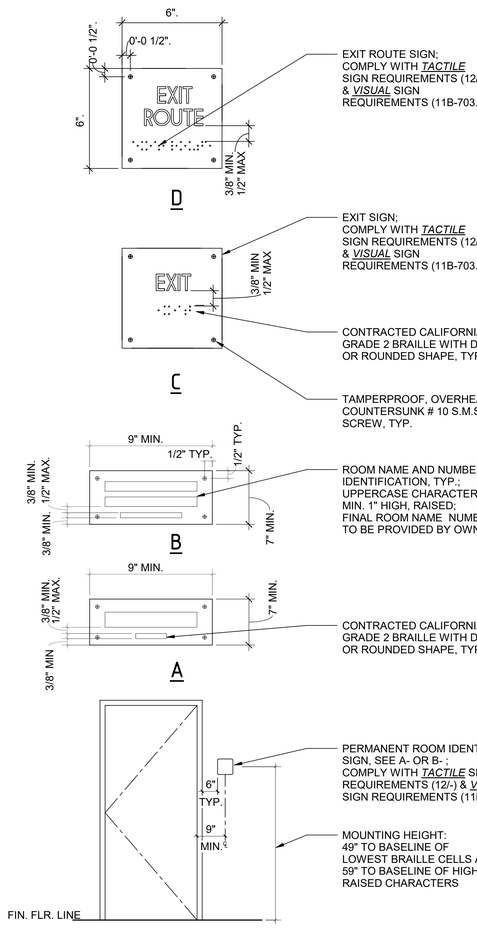

ELEVATION

NOTE:
SEE NOTES FOR ADDITIONAL TACTILE SIGN REQUIREMENTS.

1 PERMANENT ROOM SIGN ELEVATION
Scale: 1/2" = 1'-0"

11B-703.2 RAISED CHARACTERS

RAISED CHARACTERS SHALL COMPLY WITH SECTION 11B-703.2 AND SHALL BE DUPLICATED IN BRAILLE COMPLYING WITH SECTION 11B-703.3. RAISED CHARACTERS SHALL BE INSTALLED IN ACCORDINACE WITH SECTION 11B-703.4.

11B-703.2.1 DEPTH: RAISED CHARACTERS SHALL BE 1/32 INCH MIN. ABOVE THEIR BACKGROUND.

11B-703.2.2 CASE: CHARACTERS SHALL BE UPPERCASE.

11B-703.2.3 STYLE: CHARACTERS SHALL BE SANS SERIF. CHARACTERS SHALL NOT BE ITALIC, OBLIQUE, SCRIPT, HIGHLY DECORATIVE, OR OF OTHER UNUSAL FORMS.

11B-703.2.4 CHARACTER PROPORTIONS: CHARACTERS SHALL BE SELECTED FROM FONTS WHERE THE WIDTH OF THE UPPERCASE LETTER "O" IS 60% MINIMUM AND 110% MAXIMUM OF THE HEIGHT OF THE UPPERCASE LETTER "I".

11B-703.2.5 CHARACTER HEIGHT: CHARACTER HEIGHT MEASURED VERTICALLY FROM THE BASELINE OF THE CHARACTER SHALL BE 5/8" MINIMUM AND 2" MAXIMUM BASED ON THE HEIGHT OF THE UPPERCASE LETTER "I".

11B-703.2.6 STROKE THICKNESS: STROKE THICKNESS OF THE UPPERCASE LETTER "I" SHALL BE 15% MAXIMUM OF THE HEIGHT OF THE CHARACTER.

11B-703.2.7 CHARACTER SPACING: CHARACTER SPACING SHALL BE MEASURED BETWEEN THE TWO CLOSEST POINTS OF ADJACENT RAISED CHARACTERS WITHIN A MESSAGE, EXCLUDING WORD SPACES. WHERE CHARACTERS HAVE RECTANGULAR CROSS SECTIONS, SPACING BETWEEN INDIVIDUAL RAISED CHARACTERS SHALL BE 1/8" MIN. AND 4 TIMES THE RAISED CHARACTER STROKE WIDTH MAXIMUM. WHERE CHARACTERS HAVE OTHER CROSS SECTIONS, SPACING BETWEEN INDIVIDUAL RAISED CHARACTERS SHALL BE 1/16" MIN. AND 4 TIMES THE RAISED CHARACTER STROKE WIDTH MAXIMUM AT THE BASE OF THE CROSS SECTIONS, AND 1/8" MIN. AND 4 TIMES THE RAISED CHARACTER STROKE WIDTH MAX. AT THE TOP OF THE CROSS SECTIONS. CHARACTERS SHALL BE SEPARATED FROM RAISED BORDERS AND DECORATIVE ELEMENTS 3/8" MINIMUM.

11B-703.2.8 LINE SPACING: SPACING BETWEEN THE BASELINES OF SEPARATE LINES OF RAISED CHARACTERS WITHIN A MESSAGE SHALL BE 135% MIN. AND 170% MAX. OF THE RAISED CHARACTER HEIGHT.

11B-703.2.9 FORMAT: TEXT SHALL BE IN A HORIZONTAL FORMAT.

11B-703.3 BRAILLE

BRAILLE SHALL BE CONTRACTED (GRADE 2) AND SHALL COMPLY WITH SECTIONS 11B-703.3 & 11B-703.4.

11B-703.3.1 DIMENSIONS AND CAPITALIZATION: BRAILLE DOTS SHALL HAVE A DOMED OR ROUNDED SHAPE AND SHALL COMPLY WITH TABLE 11B-703.3.1. THE INDICATION OF AN UPPERCASE LETTER OR LETTERS SHALL ONLY BE USED BEFORE THE FIRST WORD OF SENTENCES, PROPER NOUNS AND NAMES, INDIVIDUAL LETTERS OF THE ALPHABET, INITIALS, AND ACRONYMS.

11B-703.3.2 POSITION: BRAILLE SHALL BE POSITIONED BELOW THE CORRESPONDING TEXT IN A HORIZONTAL FORMAT, FLUSH LEFT OR CENTERED. IF TEXT IS MULTI-LINED, BRAILLE SHALL BE PLACED BELOW THE ENTIRE TEXT. BRAILLE SHALL BE SEPARATED 3/8" MIN. AND 1/2" MAX. FROM ANY OTHER TACTILE CHARACTERS AND 3/8" MIN. FROM RAISED BORDERS AND DECORATIVE ELEMENTS.

EXCEPTION: BRAILLE PROVIDED ON ELEVATOR CAR CONTROLS SHALL BE SEPARATED 3/16" MIN. AND SHALL BE LOCATED EITHER DIRECTLY BELOW THE CORRESPONDING RAISED CHARACTERS OR SYMBOLS

11B-703.4 INSTALLATION HEIGHT AND LOCATION

SIGNS WITH TACTILE CHARACTERS SHALL COMPLY WITH SECTION 11B-703.4.

11B-703.4.1 HEIGHT ABOVE FINISH FLOOR OR GROUND: TACTILE CHARACTERS ON SIGNS SHALL BE LOCATED 48" MIN. ABOVE THE FINISH FLOOR OR GROUND SURFACE MEASURED FROM THE BASELINE OF THE LOWEST BRAILLE CELLS CHARACTER, AND 60" MAX. ABOVE THE FINISH FLOOR OR GROUND SURFACE MEASURED FROM THE BASELINE OF THE HIGHEST LINE OF RAISED CHARACTERS.

EXCEPTION: TACTILE CHARACTERS FOR ELEVATOR CAR CONTROLS SHALL NOT BE REQUIRED TO COMPLY WITH SECTION 11B-703.4.1.

11B-703.4.2 LOCATION: WHERE A TACTILE SIGN IS PROVIDED AT A DOOR, THE SIGN SHALL BE LOCATED ALONGSIDE THE DOOR AT THE LATCH SIDE. WHERE A TACTILE SIGN IS PROVIDED AT DOUBLE DOORS WITH ONE ACTIVE LEAF, THE SIGN SHALL BE LOCATED ON THE INACTIVE LEAF. WHERE A TACTILE SIGN IS PROVIDED AT DOUBLE DOORS WITH TWO ACTIVE LEAFS, THE SIGN SHALL BE LOCATED TO THE RIGHT OF THE RIGHT HAND DOOR. WHERE THERE IS NO WALL SPACE AT THE LATCH SIDE OF A SINGLE DOOR OR AT THE RIGHT SIDE OF DOUBLE DOORS, SIGNS SHALL BE LOCATED ON THE NEAREST ADJACENT WALL. SIGNS CONTAINING TACTILE CHARACTERS SHALL BE LOCATED SO THAT A CLEAR FLOOR SPACE OF 18" MIN. BY 18" MIN., CENTERED ON THE TACTILE CHARACTERS, IS PROVIDED BEYOND THE ARC OF ANY DOOR SWING BETWEEN THE CLOSED POSITION AND 45 DEGREE OPEN POSITION. WHERE PROVIDED, SIGNS IDENTIFYING PERMANENT ROOMS AND SPACES SHALL BE LOCATED AT THE ENTRANCE TO, AND OUTSIDE OF THE ROOM OR SPACE. WHERE PROVIDED, SIGNS IDENTIFYING EXITS SHALL BE LOCATED AT THE EXIT DOOR WHEN APPROACHED IN THE DIRECTION OF EGRESS TRAVEL.

EXCEPTION: IN ALTERATIONS WHERE SIGN INSTALLATION LOCATIONS IDENTIFIED IN SECTION 11B-703.4.2 ARE OBSTRUCTED OR OTHERWISE UNAVAILABLE FOR SIGN INSTALLATION, SIGNS WITH TACTILE CHARACTERS SHALL BE PERMITTED ON THE PUSH SIDE OF DOORS WITH CLOSERS AND WITHOUT HOLD-OPEN DEVICES.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 03-120551 INC:
REVIEWED FOR
SS ☑ FLS ☑ ACS ☑
DATE: 01/11/2021

REVISIONS

LICENSED ARCHITECT
HELENA L. JUBANY
No. 022214
Ren. 5-31-21
STATE OF CALIFORNIA

NORWALK LA MIRADA UNIFIED SCHOOL DISTRCT

LA MIRADA HIGH SCHOOL NEW FOOTBALL STADIUM PROJECT

13520 ADELFA DRIVE, LA MIRADA, CA. 90638

DSA # 03-120551

NAC ARCHITECTURE

NAC NO. 161-19015
DATE 12/10/2020

DSA BACKCHECK SUBMISSION

SIGNAGE DETAILS

A5.10

© 2020 NAC Inc