


REVISIONS

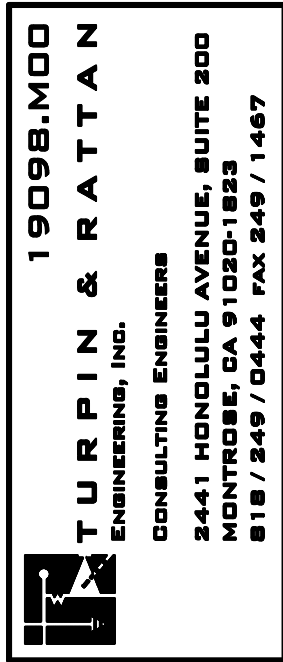

NORWALK LA MIRADA UNIFIED SCHOOL DISTRICT
LA MIRADA HIGH SCHOOL NEW FOOTBALL STADIUM PROJECT
13520 JOE EFA DRIVE, LA MIRADA, CA 90638

DSA # 03-120551

NAC
ARCHITECTURE

NAC NO. 161-19015
DATE 12/10/2020


DSA BACKCHECK
SUBMISSION

MECHANICAL
CONTROL
DIAGRAMS


M0.03

NOTES


1. 24V INTERFACE KITS REQUIRED, ONE PER SPLIT SYSTEM IN ORDER TO PROVIDE THERMOSTAT INSTALLATION CAPABILITY.

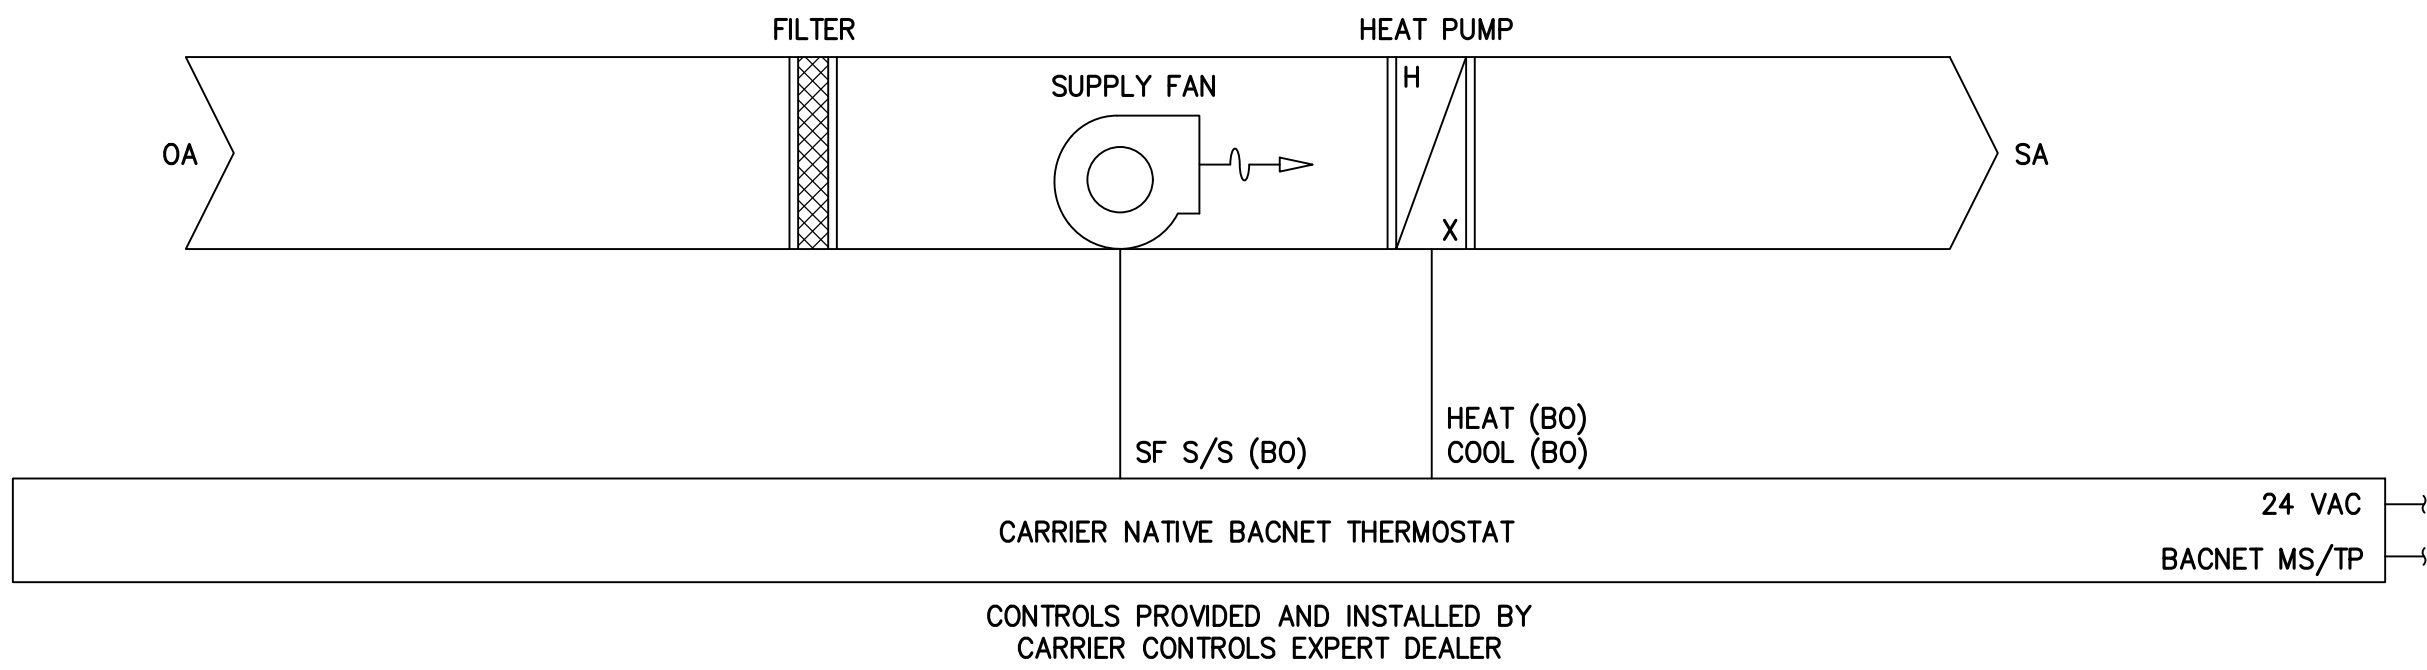

CONTROLS PROVIDED AND INSTALLED BY
CARRIER CONTROLS EXPERT DEALER

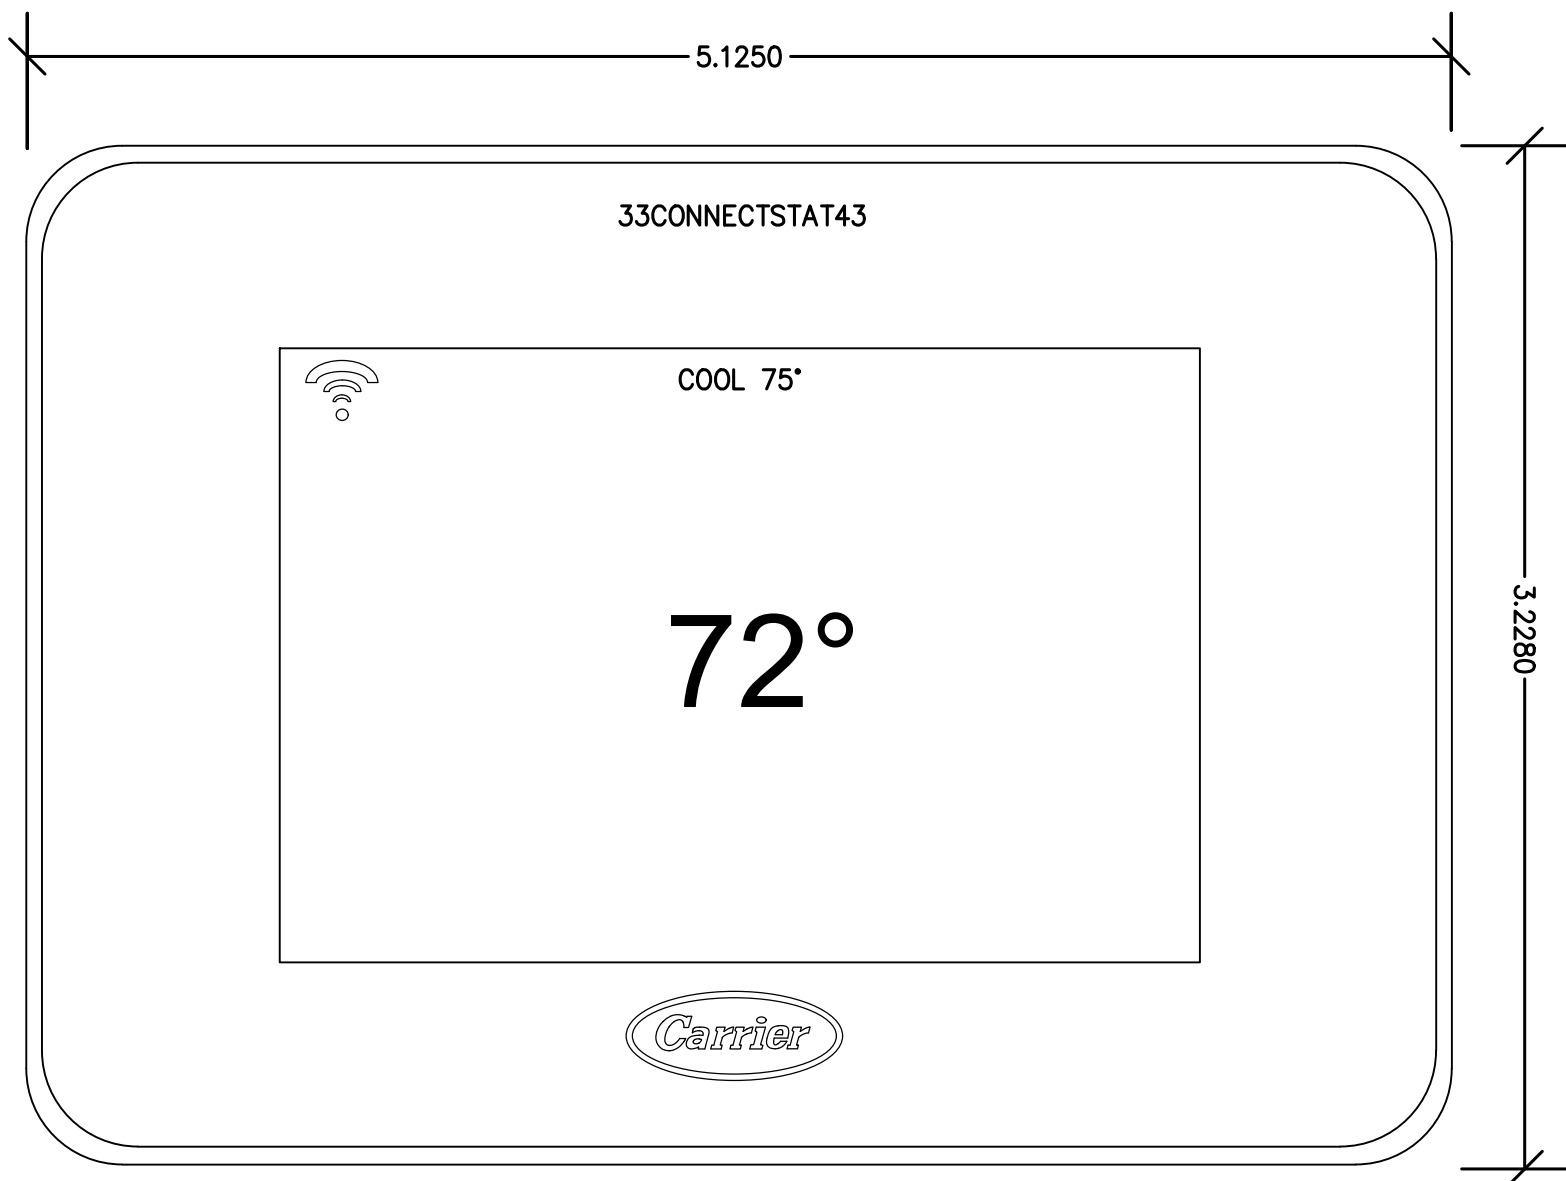

BACNET COMMUNICATION	A+
	B-
GROUND POWER	C
	R
OPTIONAL INPUT TERMINALS	S1
	S2

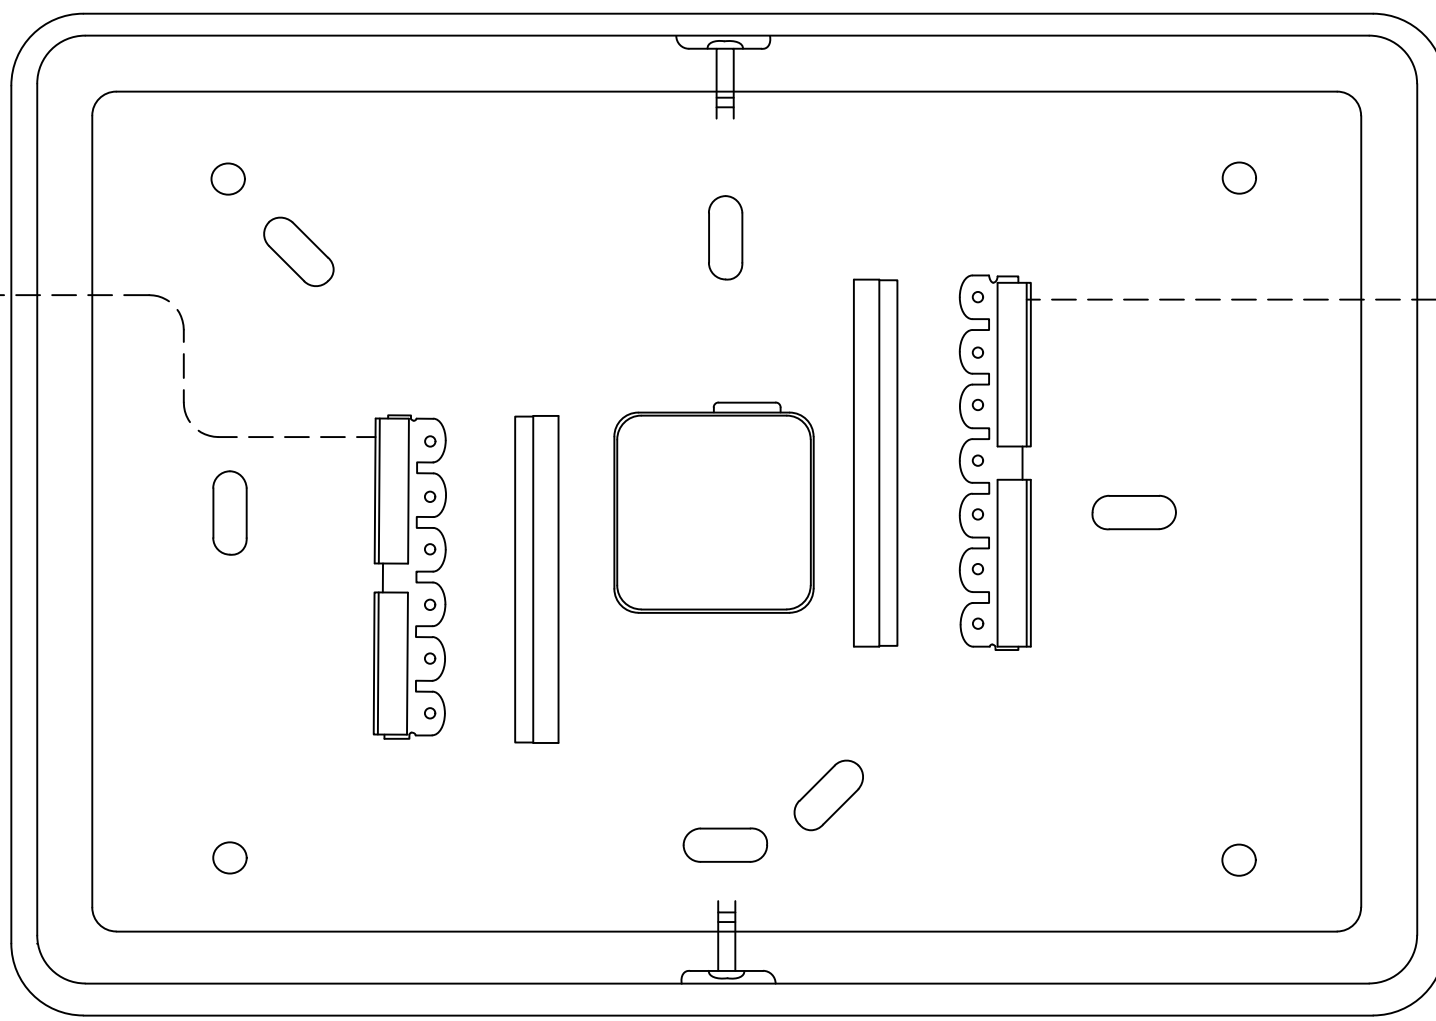

- TITLE-24 110.12 (JAS)/IECC C403.4 COMPLIANT**
- OCCUPANT CONTROLLED SMART THERMOSTAT (OCST)
THERMOSTAT PROVIDED BY EQUIPMENT MANUFACTURER
COMMUNICATIONS
- WIRED-BACNET MS/TP FOR INTEROPERABLE CONNECTIVITY
NOTES
- PROVIDE LOCAL MANUAL OVER-RIDE SWITCH FOR EACH T'STAT

SPLIT SYSTEM T-STAT DETAIL

NO SCALE