

SHEET NOTES

①

6"Ø EXHAUST DUCT UTR, TERMINATE 6"Ø EXHAUST AIR DUCT WITH ROOF JACK.

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITECT

APP: 03-120551 INC:

REVIEWED FOR

SS ☒ FLS ☒ ACS ☒

DATE: 01/11/2021

REVISIONS



1909B.M00

TURPIN & RATTAN


ENGINEERING, INC.

CONSULTING ENGINEERS

1400 ROCKAWAY AVENUE SUITE 300

MONTROSE, CA 91025-1888

818 / 249 / 0444 FAX 818 / 1487

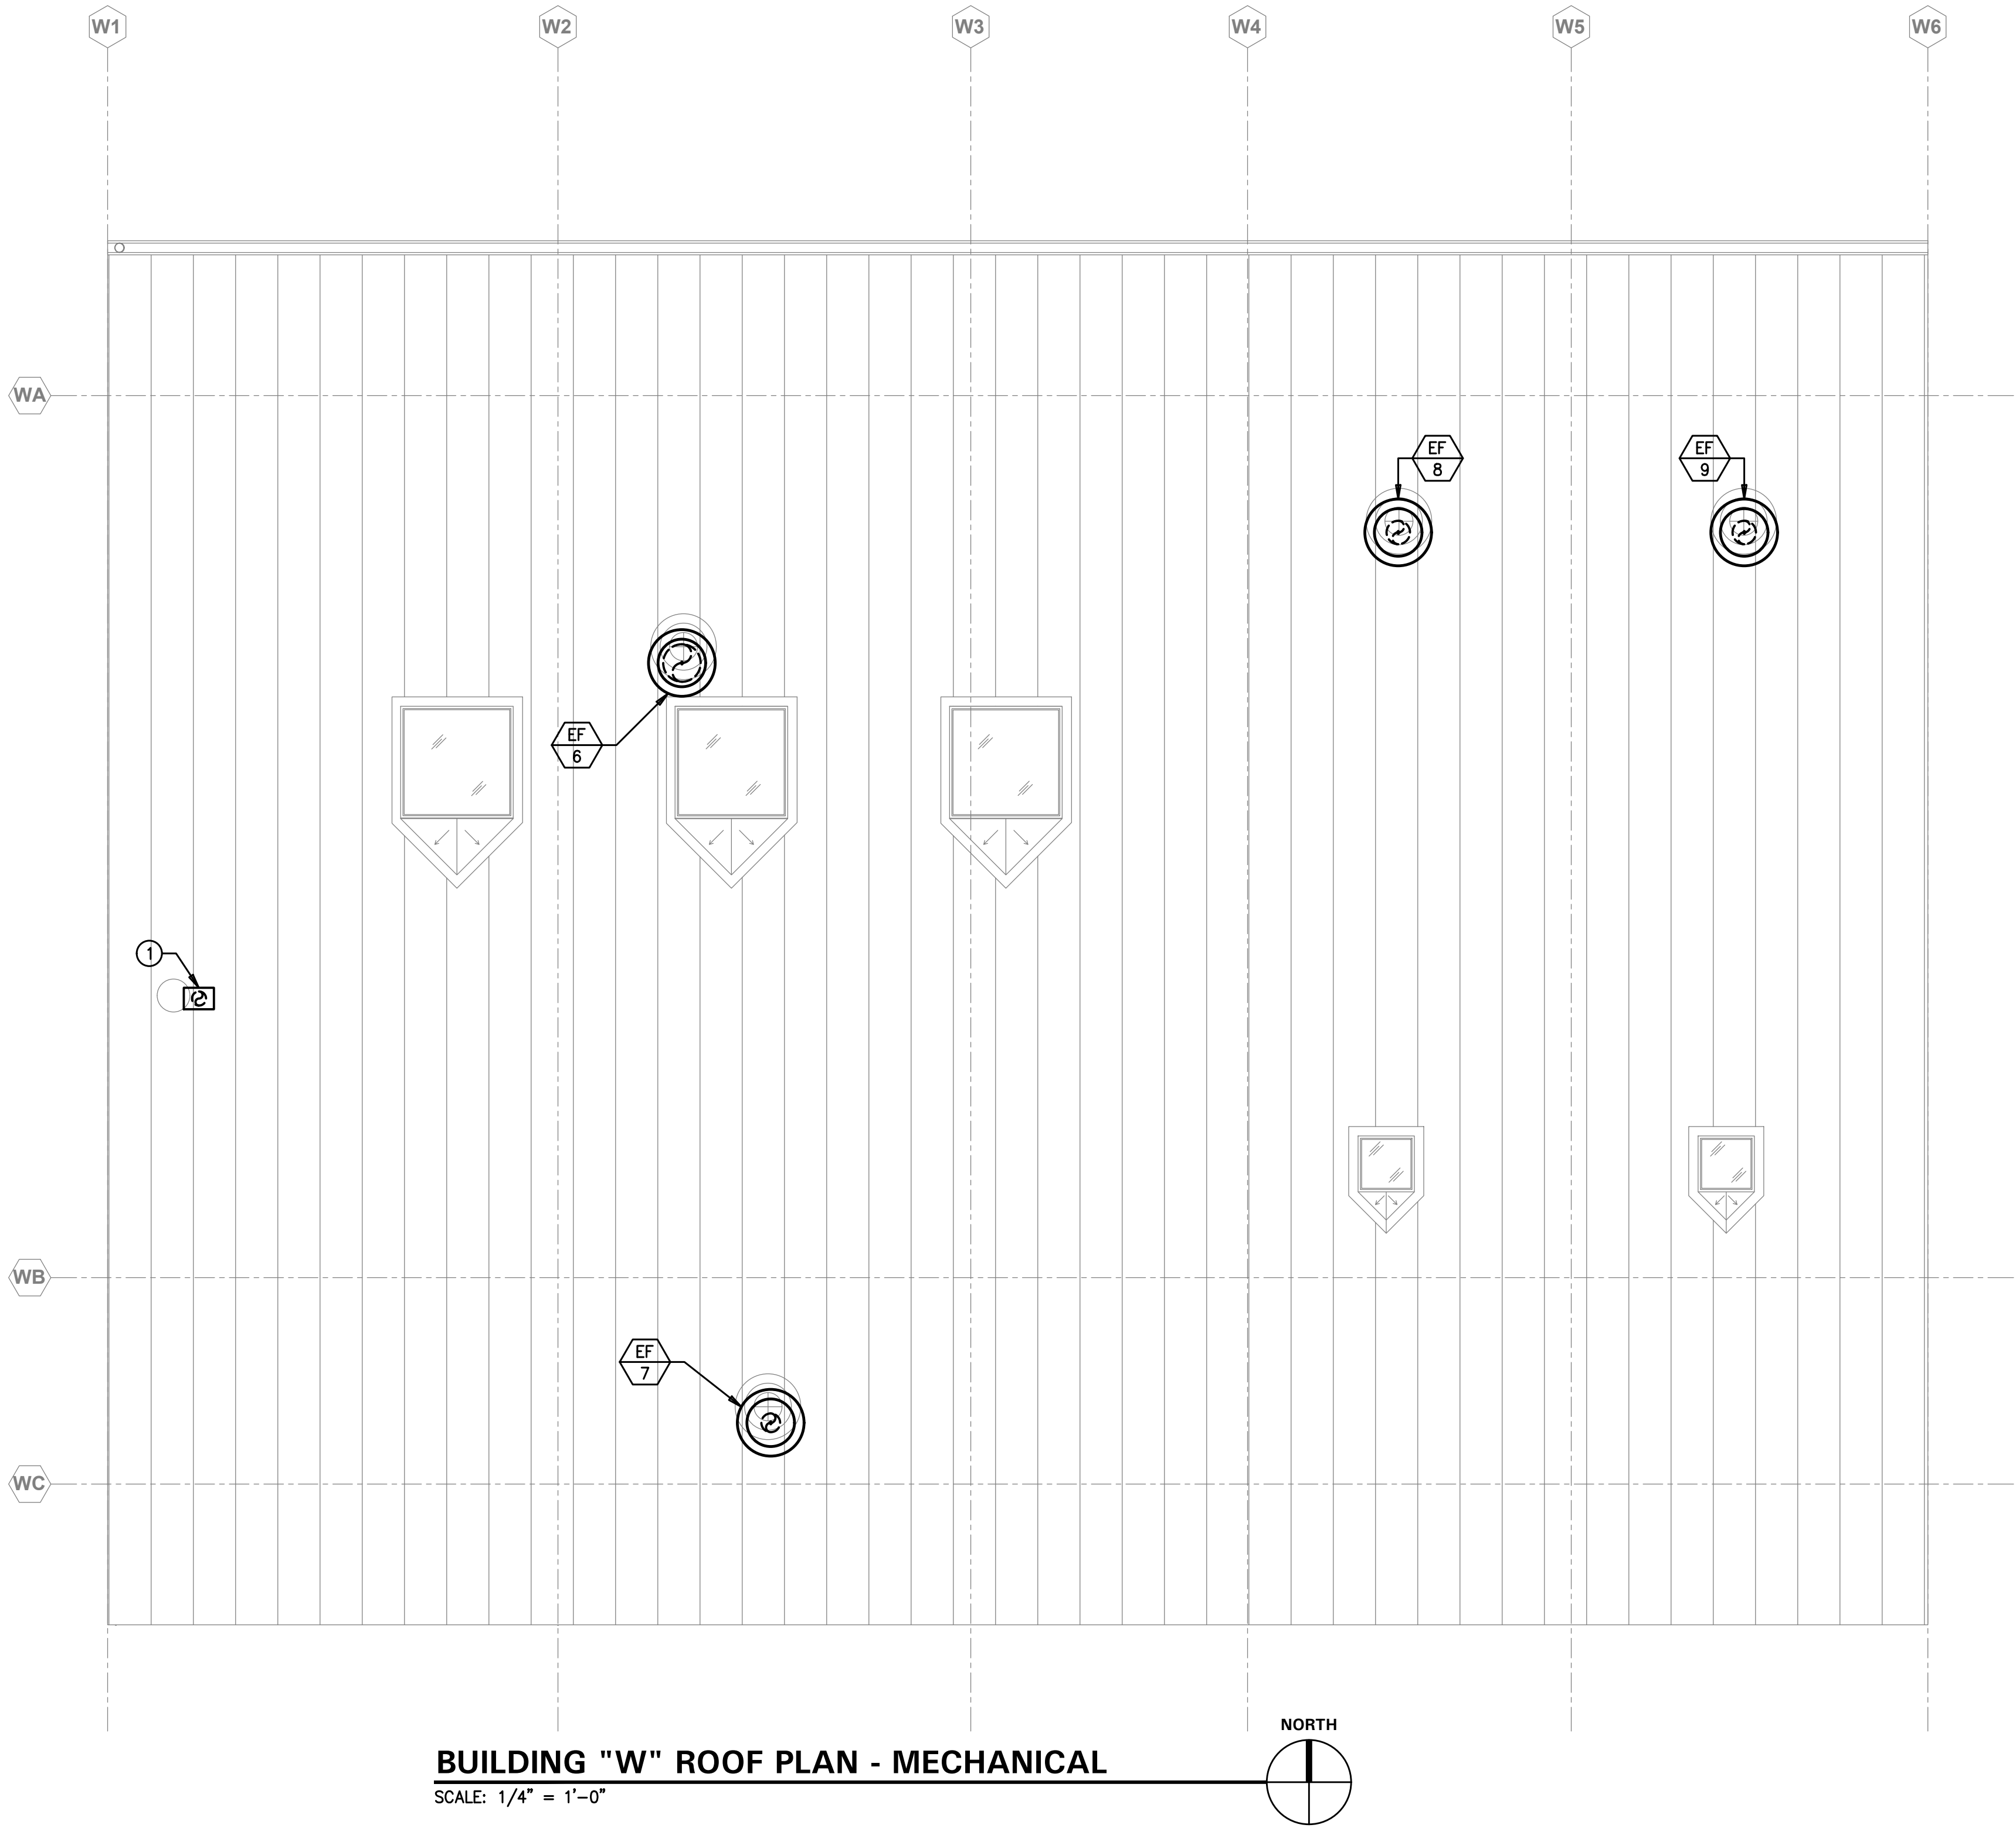

NORWALK LA MIRADA UNIFIED SCHOOL DISTRICT
LA MIRADA HIGH SCHOOL NEW FOOTBALL
STADIUM PROJECT
13520 ADELFA DRIVE, LA MIRADA, CA 91638

DSA # 03-120551

NAC
ARCHITECTURE

NAC NO. 161-19015
DATE 12/10/2020

DSA BACKCHECK
SUBMISSION

ROOF PLANS
BUILDING "W" -
MECHANICAL

M7.04