

KEYNOTES - THIS SHEET ONLY

- EXISTING 4" CONDUIT WITH EXISTING DATA CABLES (COPPER AND/OR FIBER OPTIC). INSTALL NEW FIBER OPTIC CABLE PER RISER DIAGRAM TO SERVE NEW IDF IN NEW ELECTRIC ROOM.
- EXISTING 2" CONDUIT WITH EXISTING FIRE ALARM CABLES TO REMAIN. INSTALL NEW FIRE ALARM CABLES PER THE FIRE ALARM RISER DIAGRAM.
- EXISTING MDF. PROVIDE NEW FIBER OPTIC INTERFACE AND JUMPER TO CONNECT NEW FIBER OPTIC CABLE TO SERVE NEW IDF IN NEW ELECTRIC ROOM. REFER TO SPECIFICATIONS.
- EXISTING FIRE ALARM CONTROL PANEL (FACP). PROVIDE NEW FIBER OPTIC INTERFACE AS WELL AS ALL PROGRAMMING TO CONNECT TO NEW SUB-PANEL IN ELECTRIC ROOM. REFER TO FIRE ALARM NOTES REGARDING MAINTENANCE OF SERVICE AND TESTING.
- NEW 2'x3' IN-GRADE PULLBOX. SEE COORDINATE EXACT LOCATION IN THE FIELD WITH DISTRICT REPRESENTATIVE. (NEAR BASEBALL DUGOUT)
- SPARE CONDUITS - TO CONTINUE THE EXISTING CONDUIT DISTRIBUTION ESTABLISHED ON THE CAMPUS. THESE CONDUITS ARE CURRENTLY EXTENDED TO ALL OTHER BUILDINGS ON CAMPUS AND THIS WILL MATCH THE EXISTING SCHEME FOR FUTURE FLEXIBILITY.
- SEE LANDSCAPE DRAWINGS FOR ADDITIONAL INFORMATION AND EXACT LOCATION.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 03-120551 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 01/11/2021

REVISIONS



1909B.MOD
TURPIN & RATTAN
Engineering, Inc.
CONSULTING ENGINEERS
13520 ADELEFA DRIVE, SUITE 200
LA MIRADA, CA 91703-1855
916 / 249 / 0444 FAX 249 / 1467

NORWALK LA MIRADA UNIFIED SCHOOL DISTRICT
LA MIRADA HIGH SCHOOL NEW FOOTBALL
STADIUM PROJECT
13520 ADELEFA DRIVE, LA MIRADA, CA 91703

DSA # 03-120551

NAC
ARCHITECTURE

NAC NO. 161-19015
DATE 08-26-2020

DSA BACKCHECK
SUBMISSION

OVERALL SITE PLAN
- ELECTRICAL


E6.01

EXISTING UNDERGROUND ELECTRICAL
UTILITIES NOTES

- IN ALL AREAS WHERE EXCAVATION OCCURS, EITHER FOR DEMOLITION OR NEW CONSTRUCTIONS, THE CONTRACTOR SHALL THOROUGHLY INVESTIGATE UNDERGROUND ELECTRICAL UTILITIES (POWER, SIGNAL, FIRE ALARM, ETC.) PRIOR TO ANY EXCAVATION.
- THE DEPTH OF THE EXISTING UTILITY SHALL BE NOTED AND COORDINATED WITH THE NEW EXCAVATION/CONSTRUCTION TO DETERMINE IF THE DEPTH OF THE UTILITY WILL REMAIN IN COMPLIANCE WITH THE C.E.C.
- THE CONTRACTOR SHALL NOTIFY THE DISTRICT, ARCHITECT, AND ENGINEER IF THE EXISTING UTILITY BECOMES A CONFLICT. NO EXCAVATION SHALL TAKE PLACE UNTIL AN ACCEPTABLE RESOLUTION HAS BEEN DETERMINED AND A COURSE OF ACTION DECIDED.

OVERALL SITE PLAN - ELECTRICAL


SCALE: 1" = 60'



NOTE:
REFER TO ENLARGED PARTIAL SITE PLANS
ON SHEETS E6.02 AND E6.03 FOR
ADDITIONAL WORK.

SECURITY ROOM 179

SCALE: 1/4" = 1'-0"

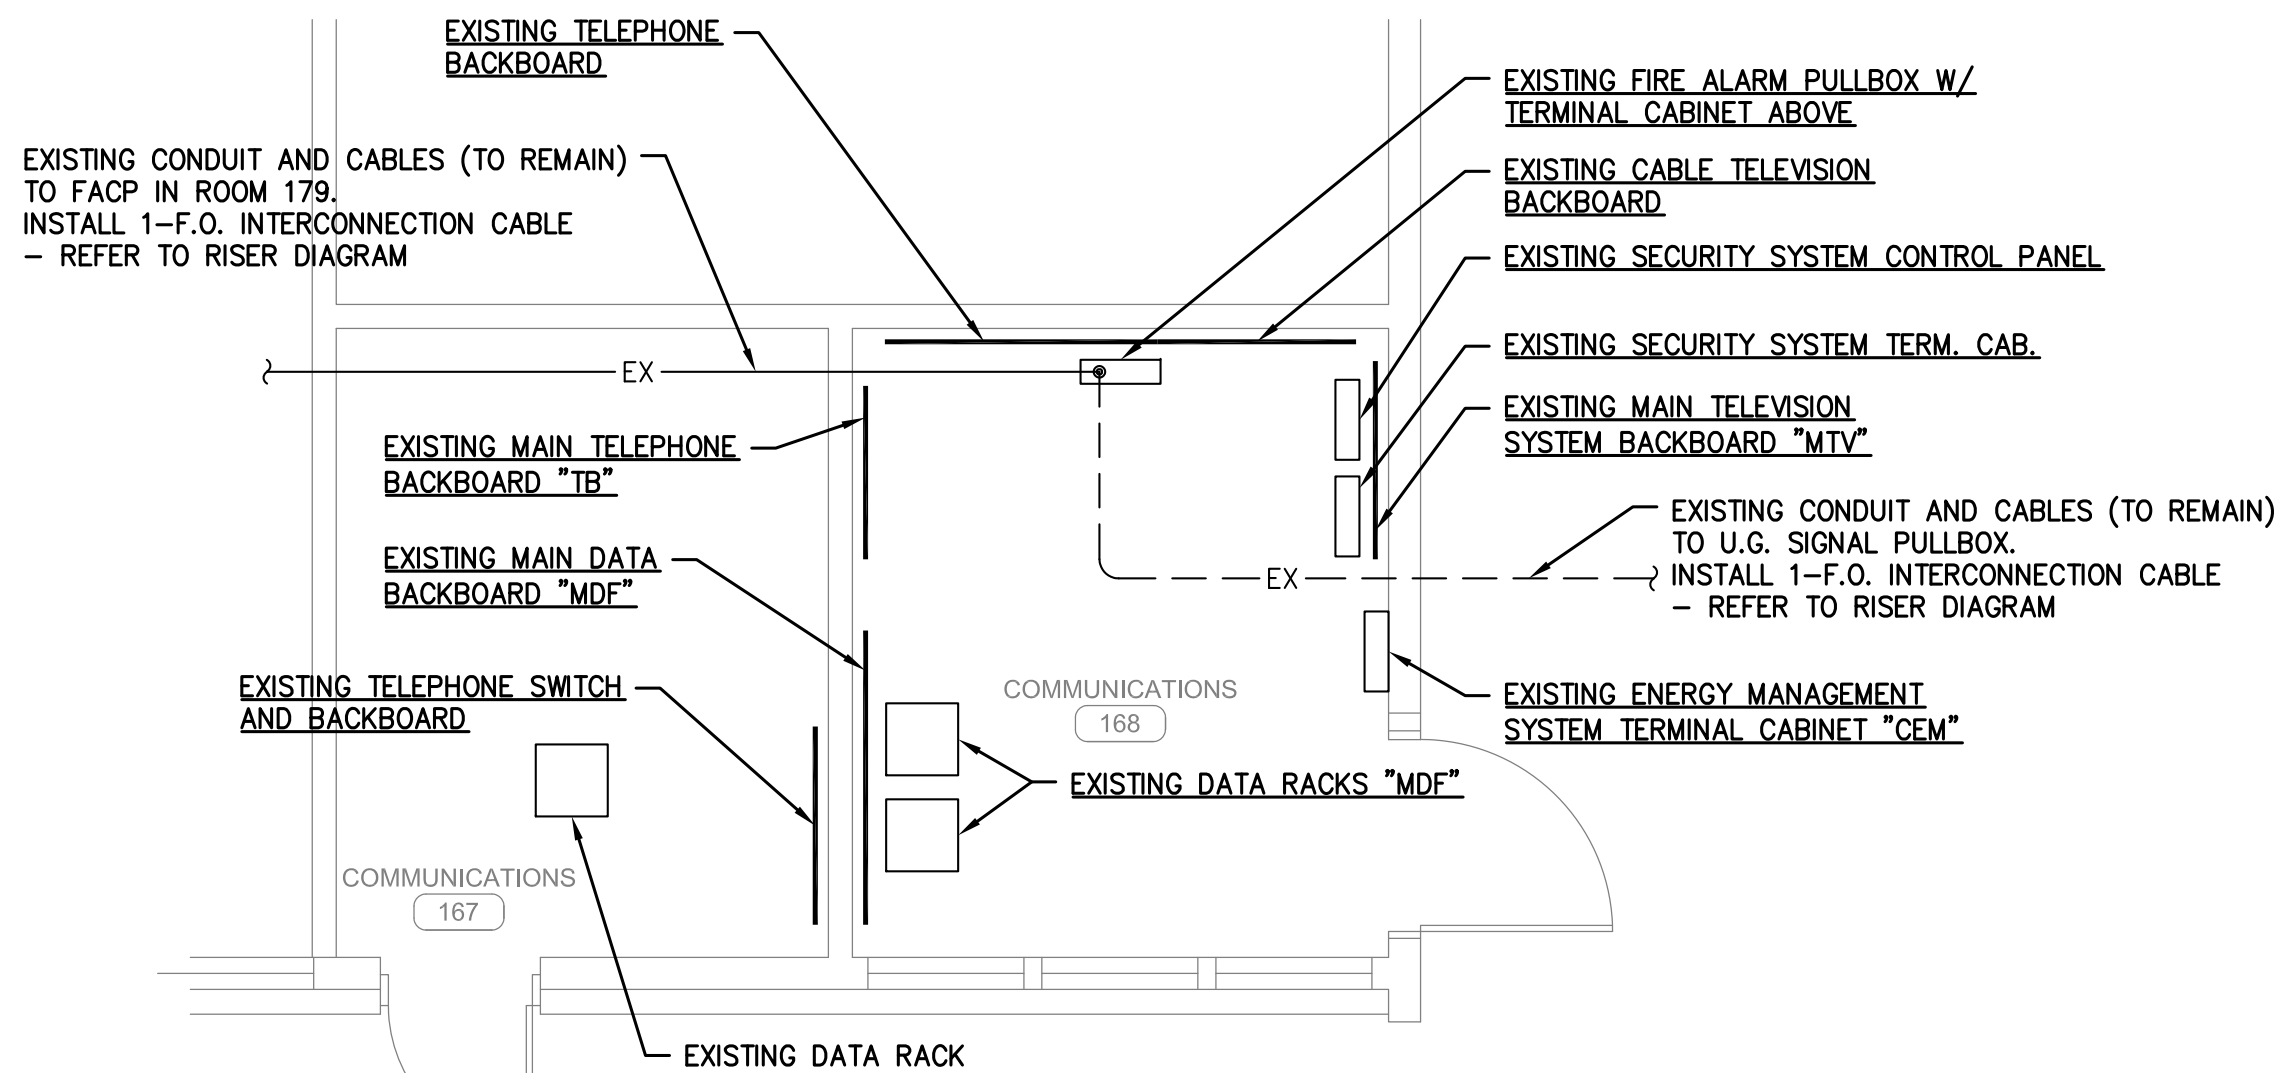

COMMUNICATIONS ROOMS 167 & 168

SCALE: 1/4" = 1'-0"