

REVISIONS



1909B.MOD
TURPIN & RATTAN
ENGINEERING, INC.
CONSULTING ENGINEERS
10000 RAVENHILL DRIVE, SUITE 200
MONTROSE, CA 91020-1855
818 / 249 / 0444 FAX 249 / 1487

NORWALK LA MIRADA UNIFIED SCHOOL DISTRICT
**LA MIRADA HIGH SCHOOL NEW FOOTBALL
STADIUM PROJECT**
13520 ADELA DRIVE, LA MIRADA, CA 90638

DSA # 03-120551


NAC
ARCHITECTURE

NAC NO. 161-19015
DATE 08-26-2020

DSA BACKCHECK
SUBMISSION

PARTIAL SITE PLAN -
ELECTRICAL
DEMOLITION

E6.11

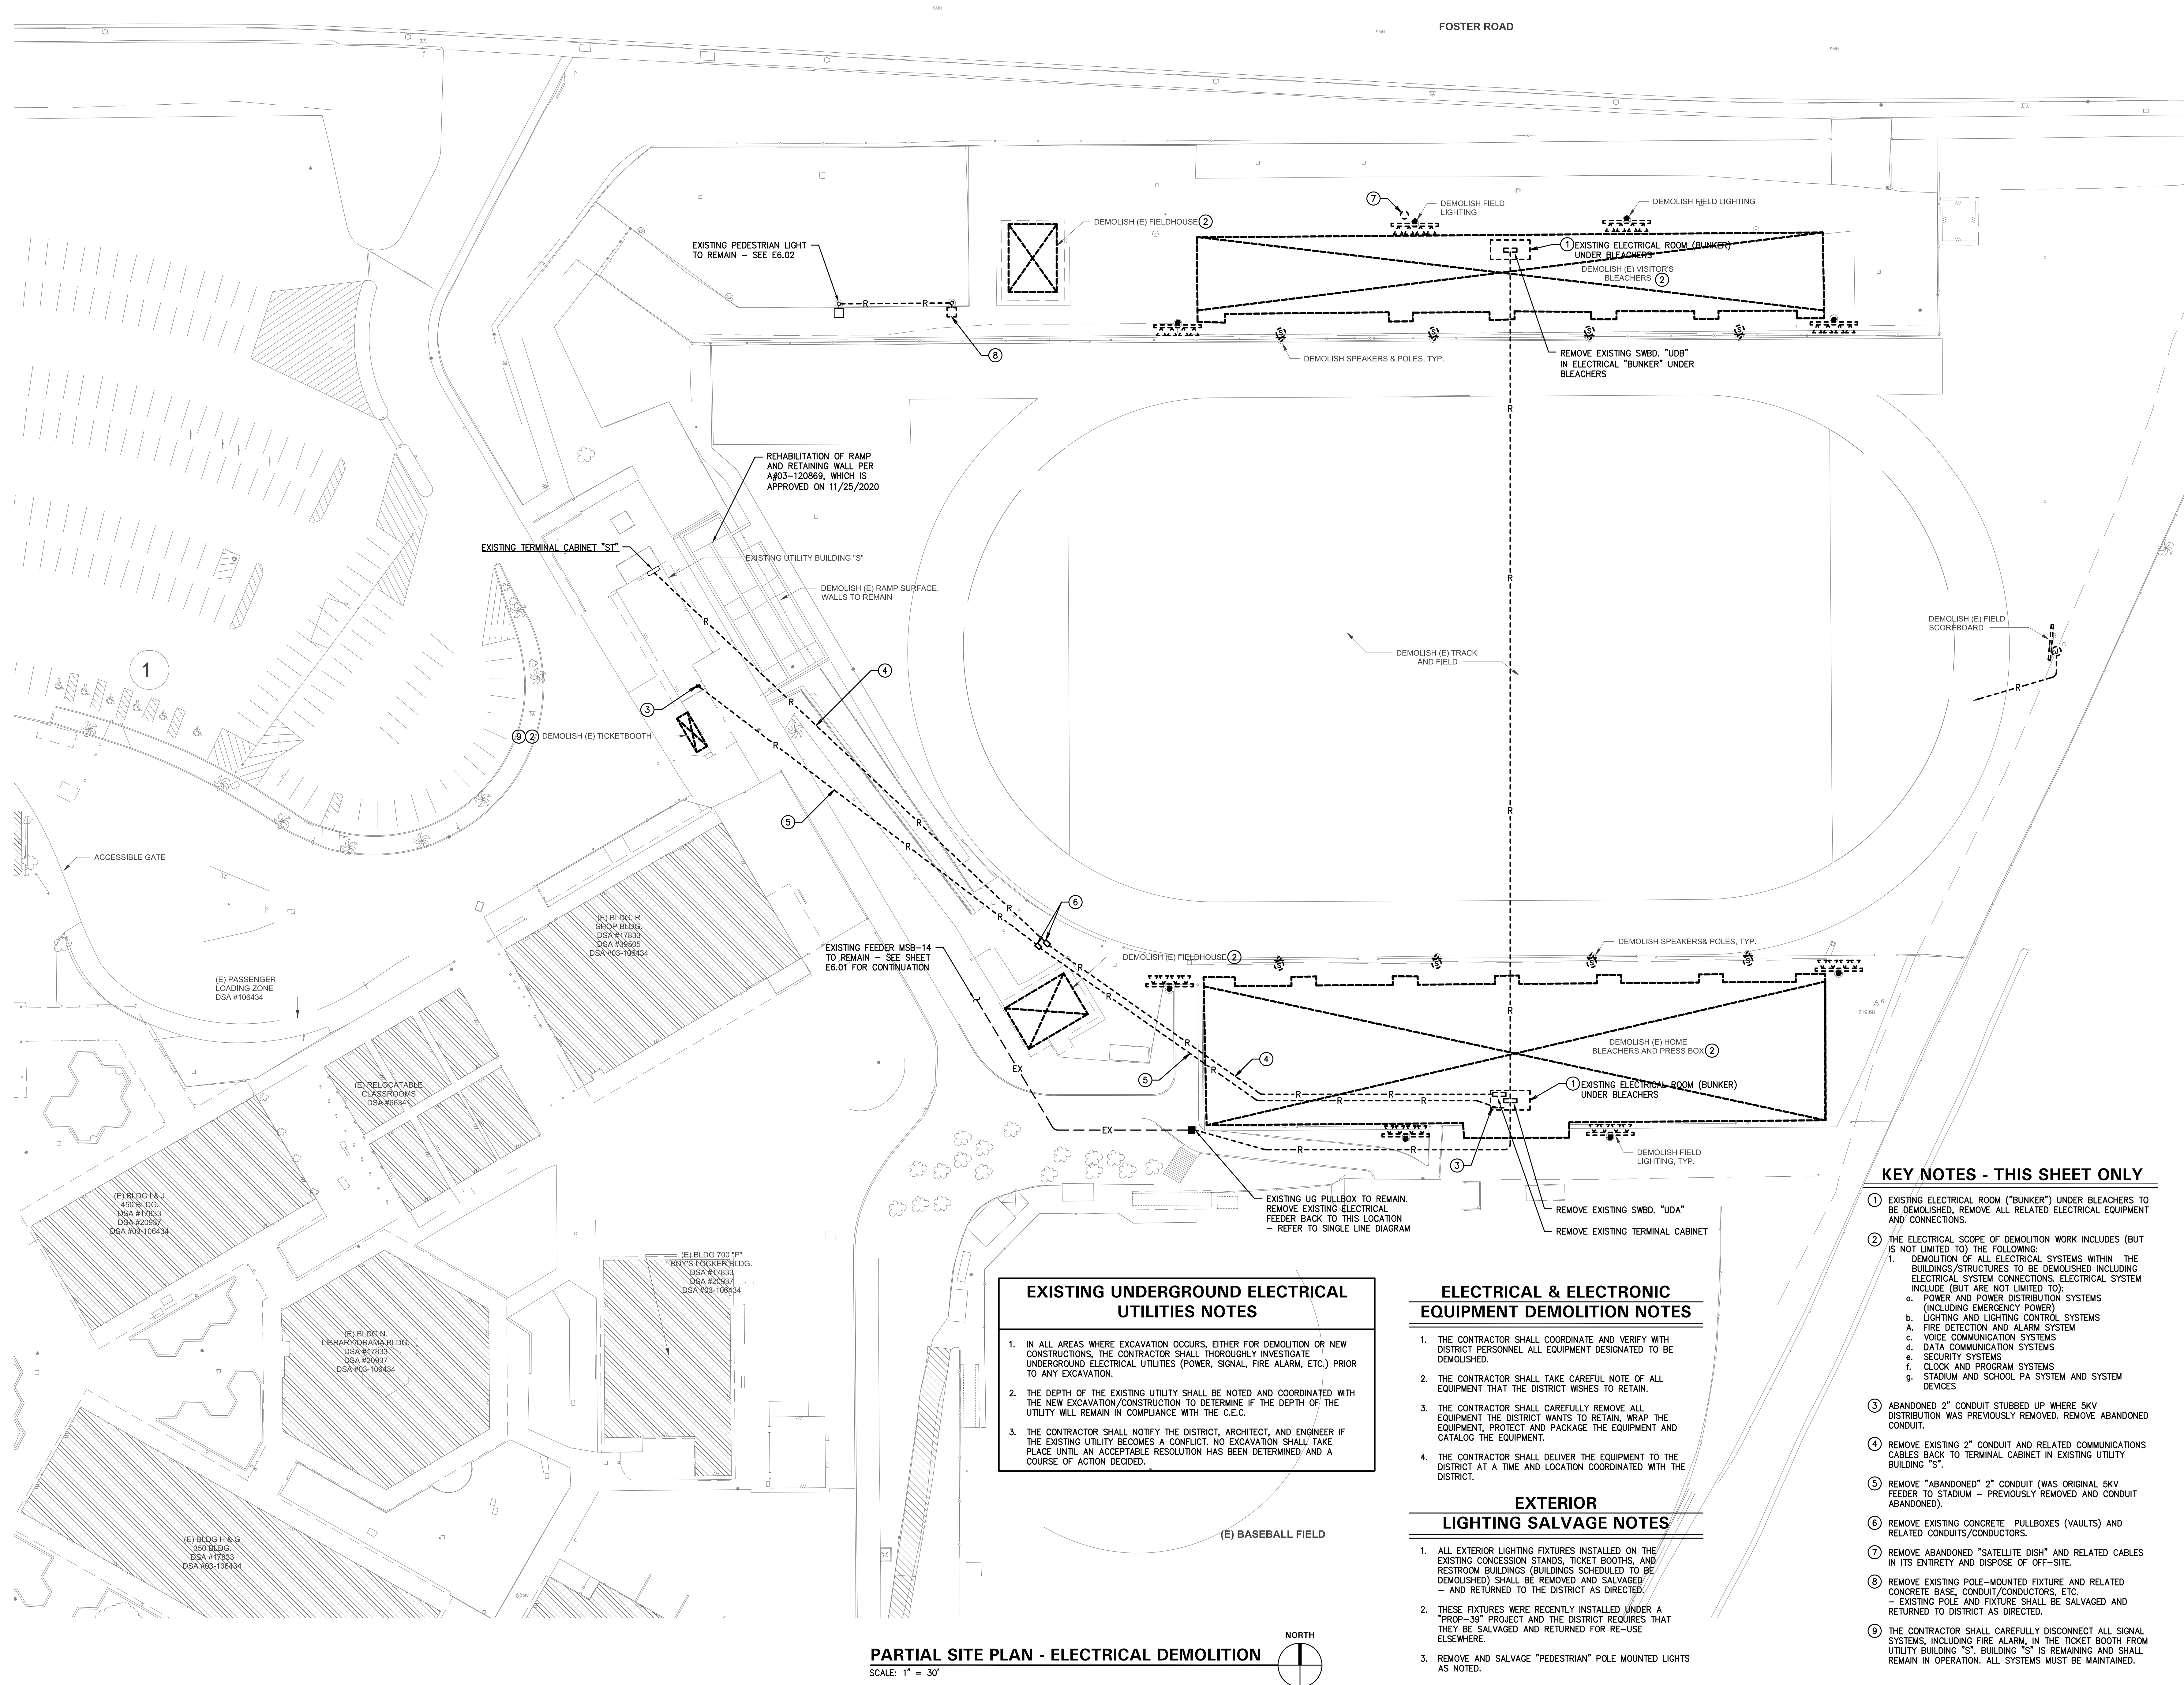

EXISTING PEDESTRIAN LIGHT
TO REMAIN - SEE E6.02

DEMOLISH (E) FIELDHOUSE ②

DEMOLISH FIELD
LIGHTING

DEMOLISH FIELD LIGHTING

① EXISTING ELECTRICAL ROOM (BUNKER)
UNDER BLEACHERS

DEMOLISH (E) VISITOR'S
BLEACHERS ②

REMOVE EXISTING SWBD, "UDB"
IN ELECTRICAL "BUNKER" UNDER
BLEACHERS

DEMOLISH SPEAKERS & POLES, TYP.

REHABILITATION OF RAMP
AND RETAINING WALL PER
A#03-120869, WHICH IS
APPROVED ON 11/25/2020

EXISTING TERMINAL CABINET "ST"

EXISTING UTILITY BUILDING "S"

DEMOLISH (E) RAMP SURFACE,
WALLS TO REMAIN

DEMOLISH (E) TRACK
AND FIELD

DEMOLISH (E) FIELD
SCOREBOARD

② DEMOLISH (E) TICKETBOOTH

(E) BLDG. R
SHOP BLDG.
DSA #17833
DSA #08695
DSA #03-106434

EXISTING FEEDER MSB-14
TO REMAIN - SEE SHEET
E6.01 FOR CONTINUATION

DEMOLISH (E) FIELDHOUSE ②

DEMOLISH SPEAKERS & POLES, TYP.

DEMOLISH (E) HOME
BLEACHERS AND PRESS BOX ②

① EXISTING ELECTRICAL ROOM (BUNKER)
UNDER BLEACHERS

DEMOLISH FIELD
LIGHTING, TYP.

EXISTING UG PULLBOX TO REMAIN.
REMOVE EXISTING ELECTRICAL
FEEDER BACK TO THIS LOCATION
- REFER TO SINGLE LINE DIAGRAM

REMOVE EXISTING SWBD, "UDA"
REMOVE EXISTING TERMINAL CABINET

**EXISTING UNDERGROUND ELECTRICAL
UTILITIES NOTES**

1. IN ALL AREAS WHERE EXCAVATION OCCURS, EITHER FOR DEMOLITION OR NEW CONSTRUCTIONS, THE CONTRACTOR SHALL THOROUGHLY INVESTIGATE UNDERGROUND ELECTRICAL UTILITIES (POWER, SIGNAL, FIRE ALARM, ETC.) PRIOR TO ANY EXCAVATION.
2. THE DEPTH OF THE EXISTING UTILITY SHALL BE NOTED AND COORDINATED WITH THE NEW EXCAVATION/CONSTRUCTION TO DETERMINE IF THE DEPTH OF THE UTILITY WILL REMAIN IN COMPLIANCE WITH THE C.E.C.
3. THE CONTRACTOR SHALL NOTIFY THE DISTRICT, ARCHITECT, AND ENGINEER IF THE EXISTING UTILITY BECOMES A CONFLICT. NO EXCAVATION SHALL TAKE PLACE UNTIL AN ACCEPTABLE RESOLUTION HAS BEEN DETERMINED AND A COURSE OF ACTION DECIDED.

**ELECTRICAL & ELECTRONIC
EQUIPMENT DEMOLITION NOTES**

1. THE CONTRACTOR SHALL COORDINATE AND VERIFY WITH DISTRICT PERSONNEL ALL EQUIPMENT DESIGNATED TO BE DEMOLISHED.
2. THE CONTRACTOR SHALL TAKE CAREFUL NOTE OF ALL EQUIPMENT THAT THE DISTRICT WISHES TO RETAIN.
3. THE CONTRACTOR SHALL CAREFULLY REMOVE ALL EQUIPMENT THE DISTRICT WANTS TO RETAIN. WRAP THE EQUIPMENT, PROTECT AND PACKAGE THE EQUIPMENT AND CATALOG THE EQUIPMENT.
4. THE CONTRACTOR SHALL DELIVER THE EQUIPMENT TO THE DISTRICT AT A TIME AND LOCATION COORDINATED WITH THE DISTRICT.

**EXTERIOR
LIGHTING SALVAGE NOTES**

1. ALL EXTERIOR LIGHTING FIXTURES INSTALLED ON THE EXISTING CONCESSION STANDS, TICKET BOOTHS, AND RESTROOM BUILDINGS (BUILDINGS SCHEDULED TO BE DEMOLISHED) SHALL BE REMOVED AND SALVAGED - AND RETURNED TO THE DISTRICT AS DIRECTED.
2. THESE FIXTURES WERE RECENTLY INSTALLED UNDER A "PROP-30" PROJECT AND THE DISTRICT REQUIRES THAT THEY BE SALVAGED AND RETURNED FOR RE-USE.
3. REMOVE AND SALVAGE "PEDESTRIAN" POLE MOUNTED LIGHTS AS NOTED.

KEY NOTES - THIS SHEET ONLY

- ① EXISTING ELECTRICAL ROOM ("BUNKER") UNDER BLEACHERS TO BE DEMOLISHED, REMOVE ALL RELATED ELECTRICAL EQUIPMENT AND CONNECTIONS.
- ② THE ELECTRICAL SCOPE OF DEMOLITION WORK INCLUDES (BUT IS NOT LIMITED TO) THE FOLLOWING:
 - a. DEMOLITION OF ALL ELECTRICAL SYSTEMS WITHIN THE BUILDINGS/STRUCTURES TO BE DEMOLISHED INCLUDING ELECTRICAL SYSTEM CONNECTIONS, ELECTRICAL SYSTEM INCLUDE (BUT ARE NOT LIMITED TO):
 - i. POWER AND POWER DISTRIBUTION SYSTEMS (INCLUDING EMERGENCY POWER)
 - ii. LIGHTING AND LIGHTING CONTROL SYSTEMS
 - iii. FIRE DETECTION AND ALARM SYSTEM
 - iv. VOICE COMMUNICATION SYSTEMS
 - v. DATA COMMUNICATION SYSTEMS
 - vi. SECURITY SYSTEMS
 - vii. CLOCK AND PROGRAM SYSTEMS
 - viii. STADIUM AND SCHOOL PA SYSTEM AND SYSTEM DEVICES
- ③ ABANDONED 2" CONDUIT STUBBED UP WHERE 5KV DISTRIBUTION WAS PREVIOUSLY REMOVED. REMOVE ABANDONED CONDUIT.
- ④ REMOVE EXISTING 2" CONDUIT AND RELATED COMMUNICATIONS CABLES BACK TO TERMINAL CABINET IN EXISTING UTILITY BUILDING "S".
- ⑤ REMOVE "ABANDONED" 2" CONDUIT (WAS ORIGINAL 5KV FEEDER TO STADIUM - PREVIOUSLY REMOVED AND CONDUIT ABANDONED).
- ⑥ REMOVE EXISTING CONCRETE PULLBOXES (VAULTS) AND RELATED CONDUITS/CONDUCTORS.
- ⑦ REMOVE ABANDONED "SATELLITE DISH" AND RELATED CABLES IN ITS ENTIRETY AND DISPOSE OF OFF-SITE.
- ⑧ REMOVE EXISTING POLE-MOUNTED FIXTURE AND RELATED CONCRETE BASE, CONDUIT/CONDUCTORS, ETC. - EXISTING POLE AND FIXTURE SHALL BE SALVAGED AND RETURNED TO DISTRICT AS DIRECTED.
- ⑨ THE CONTRACTOR SHALL CAREFULLY DISCONNECT ALL SIGNAL SYSTEMS, INCLUDING FIRE ALARM, IN THE TICKET BOOTH FROM UTILITY BUILDING "S". BUILDING "S" IS REMAINING AND SHALL REMAIN IN OPERATION. ALL SYSTEMS MUST BE MAINTAINED.

PARTIAL SITE PLAN - ELECTRICAL DEMOLITION

SCALE: 1" = 30'

